



United Technologies

**INSTALLATION, OPERATION AND
MAINTENANCE INSTRUCTIONS**



Water-Cooled Screw Chillers
Water-sourced screw heat pumps

30XW/30XW-P
30XWH/30XWHP

Nominal cooling capacity: 273-1756 kW

Nominal heating capacity: 317-1989 kW

50 Hz



Original instructions

CONTENTS

1 - INTRODUCTION	4
1.1 - Installation safety considerations	4
1.2 - Equipment and components under pressure	5
1.3 - Maintenance safety considerations	5
1.4 - Repair safety considerations	7
2 - PRELIMINARY CHECKS	8
2.1 - Check equipment received	8
2.2 - Moving and siting the unit	9
3 - DIMENSIONS, CLEARANCES	10
3.1 - 30XW-/30XWH- 254-852 – 30XW-P/30XWHP 512-862	10
3.2 - 30XW-/30XWH- 1002-1552 – 30XW-P/30XWHP 1012-1464	11
3.3 - 30XW-/30XWH- 1652-1702 – 30XW-P/30XWHP 1612-1762	12
4 - PHYSICAL AND ELECTRICAL DATA	13
4.1 - Physical data, units without options 150, 5 and 6	13
4.2 - Electrical data, units without options 150, 5 and 6	14
4.3 - Short-circuit stability current for all units	15
4.4 - Compressor electrical data 30XW	15
4.5 - Compressor usage per circuit (A, B)	15
5 - ELECTRICAL CONNECTION	16
5.1 - Power supply	16
5.2 - Voltage phase imbalance (%)	16
5.3 - Power connection/disconnect switch	16
5.4 - Recommended wire sections	16
5.5 - Power cable entry	17
5.6 - Field control wiring	17
5.7 - 24 and 230 V power reserve for the user	18
6 - APPLICATION DATA	18
6.1 - Operating limits for 30XW units	18
6.2 - Minimum chilled water flow	18
6.3 - Maximum chilled water flow	18
6.4 - Condenser water flow rate	18
6.5 - Standard and optional number of water passes	19
6.6 - Evaporator and condenser water flow rates	19
6.7 - Variable flow evaporator	19
6.8 - System minimum water volume	19
6.9 - Evaporator pressure drop curves	20
6.10 - Condenser pressure drop curves	20
7 - WATER CONNECTIONS	21
7.1 - Operating precautions	21
7.2 - Water connections	22
7.3 - Flow control	22
7.4 - Evaporator and condenser water box bolt tightening	22
7.5 - Operation of two units in master/slave mode	23
8 - HEAT MACHINE UNITS 30XWH- AND 30XWHP	23
8.1 - Physical data for Heat Machine units	23
8.2 - Electrical data for Heat Machine units	23
8.3 - Dimensions and clearances for Heat Machine units	23
8.4 - Operating range for Heat Machine units	23
8.5 - Operating modes for Heat Machine units	23

9 - OPTION FOR HIGH CONDENSING TEMPERATURES (OPTION 150)	24
9.1 - Physical data, units with option 150	24
9.2 - Electrical data, units with option 150.....	25
9.3 - Dimensions and clearances, units with option 150	26
9.4 - Operating limits, units with option 150.....	26
10 - MEDIUM TEMPERATURE (OPTION 5) AND LOW TEMPERATURE (OPTION 6) GLYCOL SOLUTION OPTIONS	26
10.1 - Physical data, units with options 5 and 6	26
10.2 - Electrical data, units with options 5 and 6.....	27
10.3 - Dimensions, clearances, units with option 5 and 6.....	27
10.4 - Operating range, units with options 5 and 6.....	27
10.5 - Minimum recommended evaporator flow rate with options 5 and 6.....	27
10.6 - Nominal evaporator pressure drop with options 5 and 6	27
11 - MAJOR SYSTEM COMPONENTS AND OPERATION DATA	28
11.1 - Direct-drive twin-screw compressor with variable capacity slide valve	28
11.2 - Pressure vessels.....	28
11.3 - High-pressure safety switch	29
11.4 - Electronic expansion valve (EXV)	29
11.5 - Moisture indicator	29
11.6 - Filter drier	29
11.7 - Sensors.....	29
12 - OPTIONS	30
13 - STANDARD MAINTENANCE	31
13.1 - Level 1 maintenance	31
13.2 - Level 2 maintenance	31
13.3 - Level 3 (or higher) maintenance	31
13.4 - Tightening of the electrical connections	31
13.5 - Tightening torques for the main bolts and screws	32
13.6 - Evaporator and condenser maintenance.....	32
13.7 - Compressor maintenance.....	32
14 - START-UP CHECKLIST FOR 30XW LIQUID CHILLERS (USE FOR JOB FILE)	34

This manual applies to the following four 30XW unit types:

- 30XW-- Standard-efficiency units
 - 30XW-P High-efficiency units
- and**
- 30XWH- Heat Machine standard-efficiency units
 - 30XWHP Heat Machine high-efficiency units

For the operation of the control please refer to the 30XA/30XW-Pro-Dialog control manual.

The cover photograph is for illustrative purposes only and is not part of any offer for sale or contract.

1 - INTRODUCTION

The 30XW Aquaforce units are designed to cool water for the air conditioning of buildings and industrial processes.

Prior to the initial start-up of the 30XW units, the people involved in the on-site installation, start-up, operation, and maintenance of this unit should be thoroughly familiar with these instructions and the specific project data for the installation site.

The 30XW liquid chillers are designed to provide a very high level of safety during installation, start-up, operation and maintenance. They will provide safe and reliable service when operated within their application range.

They are designed for an operating life of 15 years by assuming a 75% utilisation factor; that is approximately 100,000 operating hours.

This manual provides the necessary information to familiarize yourself with the control system before performing start-up procedures. The procedures in this manual are arranged in the sequence required for machine installation, start-up, operation and maintenance.

Always ensure that all required safety measures are followed, including those in this document, such as: wearing protective clothing (gloves, safety glasses and shoes) using appropriate tools, employing qualified and skilled technicians (electricians, refrigeration engineers) and following local regulations.

To find out, if these products comply with European directives (machine safety, low voltage, electromagnetic compatibility, equipment under pressure etc.) check the declarations of conformity for these products.

1.1 - Installation safety considerations

Access to the unit must be reserved to authorised personnel, qualified and trained in monitoring and maintenance. The access limitation device must be installed by the customer (e.g. cut-off, enclosure).

After the unit has been received, when it is ready to be installed or reinstalled, and before it is started up, it must be inspected for damage. Check that the refrigerant circuit(s) is (are) intact, especially that no components or pipes have shifted (e.g. following a shock). If in doubt, carry out a leak tightness check and verify with the manufacturer that the circuit integrity has not been impaired. If damage is detected upon receipt, immediately file a claim with the shipping company.

Carrier strongly recommends employing a specialised company to unload the machine.

It is compulsory to wear personal protection equipment.

Do not remove the skid or the packaging until the unit is in its final position. These units can be moved with a fork lift truck, as long as the forks are positioned in the right place and direction on the unit.

The units can also be lifted with slings, using only the designated lifting points marked on the unit.

Use slings or lifting beams with the correct capacity, and always follow the lifting instructions on the certified drawings supplied with the unit. Do not tilt the unit more than 15°.

Safety is only guaranteed, if these instructions are carefully followed. If this is not the case, there is a risk of material deterioration and injuries to personnel.

Never cover any protection devices.

This applies to the relief valves (if used) in the refrigerant or heat transfer medium circuits, the fuse plugs and the pressure switches.

Ensure that the valves are correctly installed, before operating the unit.

Classification and control

In accordance with the Pressure Equipment Directive and national usage monitoring regulations in the European Union the protection devices for these machines are classified as follows:

	Safety accessory*	Damage limitation accessory** in case of an external fire
Refrigerant side		
High-pressure switch	x	
External relief valve***		x
Rupture disk		x
Fuse plug		x
Heat transfer fluid side		
External relief valve****	x	

* Classified for protection in normal service situations.

** Classified for protection in abnormal service situations.

*** The instantaneous over-pressure limited to 10% of the operating pressure does not apply to this abnormal service situation. The control pressure can be higher than the service pressure. In this case either the design temperature or the high-pressure switch ensures that the service pressure is not exceeded in normal service situations.

**** The classification of these relief valves must be made by the personnel that completes the whole hydronic installation.

If the relief valves are installed on a change-over manifold, this is equipped with a relief valve on each of the two outlets. Only one of the two relief valves is in operation, the other one is isolated. Never leave the change-over valve in the intermediate position, i.e. with both ways open (locate the control element in the stop position). If a relief valve is removed for checking or replacement please ensure that there is always an active relief valve on each of the change-over valves installed in the unit.

All factory-installed relief valves are lead-sealed to prevent any calibration change.

The external relief valves and the fuses are designed and installed to ensure damage limitation in case of a fire.

In accordance with the regulations applied for the design, the European directive on equipment under pressure and in accordance with the national usage regulations:

- These relief valves and fuses are not safety accessories but damage limitation accessories in case of a fire,***
- The high pressure switches are the safety accessories.***

The relief valve must only be removed if the fire risk is fully controlled and after checking that this is allowed by local regulations and authorities. This is the responsibility of the operator.

When the unit is subjected to fire, safety devices prevent rupture due to over-pressure by releasing refrigerant. The fluid may then be decomposed into toxic residues when subjected to the flame:

- *Stay away from the unit*
- *Set up warnings and recommendations for personnel in charge to stop the fire.*
- *Fire extinguishers appropriate to the system and the refrigerant type must be easily accessible.*

The external relief valves must in principle be connected to discharge pipes for units installed in a room. Refer to the installation regulations, for example those of European standards EN 378 and EN 13136.

They include a sizing method and examples for configuration and calculation. Under certain conditions these standards permit connection of several valves to the same discharge pipe. Note: Like all other standards these EN standards are available from national standards organizations.

These pipes must be installed in a way that ensures that people and property are not exposed to refrigerant leaks. These fluids may be diffused in the air, but far away from any building air intake, or they must be discharged in a quantity that is appropriate for a suitably absorbing environment.

It is recommended to install an indicating device to show if part of the refrigerant has leaked from the valve. The presence of oil at the outlet orifice is a useful indicator that refrigerant has leaked. Keep this orifice clean to ensure that any leaks are obvious.

The calibration of a valve that has leaked is generally lower than its original calibration. The new calibration may affect the operating range. To avoid a nuisance tripping or leaks, replace or re-calibrate the valve.

Periodic check of the relief valves: See paragraph 1.3 “Maintenance safety considerations”.

Provide a drain in the discharge circuit, close to each relief valve, to avoid an accumulation of condensate or rain water.

Ensure good ventilation, as accumulation of refrigerant in an enclosed space can displace oxygen and cause asphyxiation or explosions.

Inhalation of high concentrations of vapour is harmful and may cause heart irregularities, unconsciousness, or death. Vapour is heavier than air and reduces the amount of oxygen available for breathing. These products cause eye and skin irritation. Decomposition products are hazardous.

1.2 - Equipment and components under pressure

The units are intended to be stored and operate in an environment where the ambient temperature must not be less than the lowest allowable temperature indicated on the nameplate. See section “11.2 - Pressure vessels”.

1.3 - Maintenance safety considerations

Carrier recommends the following drafting for a logbook (the table below should not be considered as reference and does not involve Carrier responsibility):

Intervention		Name of the commissioning engineer	Applicable national regulations	Verification Organism
Date	Nature ⁽¹⁾			

(1) Maintenance, repairs, regular verifications (EN 378), leakage, etc.

Engineers working on the electric or refrigeration components must be authorized, trained and fully qualified to do so.

All refrigerant circuit repairs must be carried out by a trained person, fully qualified to work on these units. He must have been trained and be familiar with the equipment and the installation. All welding operations must be carried out by qualified specialists.

The insulation must be removed and heat generation must be limited by using a wet cloth.

Any manipulation (opening or closing) of a shut-off valve must be carried out by a qualified and authorised engineer. These procedures must be carried out with the unit shut-down.

NOTE: *The unit must never be left shut down with the liquid line valve closed, as liquid refrigerant can be trapped between this valve and the expansion device. (This valve is situated on the liquid line before the filter drier box.)*

During any handling, maintenance and service operations the engineers working on the unit must be equipped with safety gloves, glasses, shoes and protective clothing.

Never work on a unit that is still energized.

Never work on any of the electrical components, until the general power supply to the unit has been cut using the disconnect switch(es) in the control box(es).

If any maintenance operations are carried out on the unit, lock the power supply circuit in the open position ahead of the machine.

If the work is interrupted, always ensure that all circuits are still deenergized before resuming the work.

ATTENTION: *Even if the unit has been switched off, the power circuit remains energized, unless the unit or circuit disconnect switch is open. Refer to the wiring diagram for further details. Attach appropriate safety labels.*

Operating checks:

IMPORTANT INFORMATION REGARDING THE REFRIGERANT USED:

- *This product contains fluorinated greenhouse gas covered by the Kyoto protocol.*
Fluid type: R-134A
Global Warming Potential (GWP): 1430

CAUTION:

1. *Prevent the release of fluorinated gas from the unit. Ensure that fluorinated gas is never released to the atmosphere during installation, maintenance or disposal. If a leak of fluorinated gas is detected, ensure the leak is stopped and repaired as quickly as possible.*
 2. *Only a qualified service technician is allowed to access this product and to correct the fault.*
 3. *Any handling of fluorinated gas contained in this product (e.g. removing the charge or topping up the gas) must comply with the F-Gas Directive (EC) No. 842/2006 concerning certain fluorinated greenhouse gases and any other applicable local legislation.*
 4. *The gas recovery for recycling, regeneration or destruction is at customer charge.*
 5. *The deliberate gas release is strictly not allowed.*
 6. *Contact your local dealer or installer if you have any questions.*
- *Carry out periodic leak tests. In the European Union, article 2 of regulation (EU) No.517/2014 makes these mandatory and sets their frequency. The table below shows this frequency, as originally published in the regulation. Check whether an inspection frequency is also set by other regulations or standards applicable to your system (e.g. EN 378, ISO 5149, etc.).*

A logbook must be established for the systems that require a tightness check. It should contain the quantity and the type of fluid present within the installation (added and recovered), the quantity of recycled fluid, the date and output of the leak test, the designation of the operator and its belonging company, etc.

Leak test periodicity:

System WITHOUT leakage detection	No check	12 months	6 months	3 months	
System WITH leakage detection	No check	24 months	12 months	6 months	
CO ₂ equivalent/ circuit	tonnes	< 5	5 ≤ charge 50	50 ≤ charge < 500	charge > 500
Refrigerant charge/circuit	kg of R134A	charge < 3.5	3.5 ≤ charge < 34.9	34.9 ≤ charge < 349.7	charge > 349.7

- *During the life-time of the system, inspection and tests must be carried out in accordance with national regulations.*

Protection device checks (EN 378):

The safety devices must be checked on site once a year for safety devices (see chapter 11.3 - High-pressure safety switch), and every five years for external overpressure devices (external relief valves).

The company or organisation that conducts a pressure switch test shall establish and implement a detailed procedure to fix:

- Safety measures
- Measuring equipment calibration
- Validating operation of protective devices
- Test protocols
- Recommissioning of the equipment.

Consult Carrier Service for this type of test. Carrier mentions here only the principle of a test without removing the pressure switch:

- Verify and record the set-points of pressure switches and relief devices (valves and possible rupture discs)
- Be ready to switch-off the main disconnect switch of the power supply if the pressure switch does not trigger (avoid over-pressure or excess gas in case of valves on the high-pressure side with the recovery condensers)
- Connect a calibrated pressure gauge (the values displayed on the user interface may be inaccurate in an instant reading because of the scanning delay applied in the control)
- Neutralise the HP soft valve
- Cut the condenser water flow
- Check the cut-off value
- Reactivate HP soft valve
- Reactivate manually HP switch.

CAUTION: *If the test leads to replacing the pressure switch, it is necessary to recover the refrigerant charge, these pressure switches are not installed on automatic valves (Schraeder type).*

At least once a year thoroughly inspect the protection devices (valves). If the machine operates in a corrosive environment, inspect the protection devices more frequently.

Ensure regularly that the vibration levels remain acceptable and close to those at the initial unit start-up.

Before opening a refrigerant circuit, purge and consult the pressure gauges.

Change the refrigerant when there are equipment failures, following a procedure such as the one described in NF E29-795 or carry out a refrigerant analysis in a specialist laboratory.

If the refrigerant circuit remains open for longer than a day after an intervention (such as a component replacement), the openings must be plugged and the circuit must be charged with nitrogen (inertia principle). The objective is to prevent penetration of atmospheric humidity and the resulting corrosion on the internal walls and on non-protected steel surfaces.

1.4 - Repair safety considerations

It is compulsory to wear personal protection equipment.

The insulation must be removed and warming up must be limited by using a wet cloth.

Before opening the unit always ensure that the circuit has been purged.

If work on the evaporator is required, ensure that the piping from the compressor is no longer pressurised (as the valve is not leaktight in the compressor direction.)

All installation parts must be maintained by the personnel in charge, in order to avoid material deterioration and injuries to people. Faults and leaks must be repaired immediately. The authorized technician must have the responsibility to repair the fault immediately. Each time repairs have been carried out to the unit, the operation of the protection devices must be re-checked.

Comply with the regulations and recommendations in unit and HVAC installation safety standards, such as: EN 378, ISO 5149, etc.

If a leak occurs or if the refrigerant becomes contaminated (e.g. by a short circuit in a motor) remove the complete charge using a recovery unit and store the refrigerant in mobile containers.

Repair the leak detected and recharge the circuit with the total R-134a charge, as indicated on the unit name plate. Certain parts of the circuit can be isolated. Only charge liquid refrigerant R-134a at the liquid line.

Ensure that you are using the correct refrigerant type before recharging the unit.

Charging any refrigerant other than the original charge type (R-134a) will impair machine operation and can even lead to a destruction of the compressors. The compressors operating with this refrigerant type are lubricated with a synthetic polyolester oil.

RISK OF EXPLOSION:



Do not use oxygen to purge lines or to pressurize a machine for any purpose. Oxygen gas reacts violently with oil, grease, and other common substances.

Never exceed the specified maximum operating pressures. Verify the allowable maximum high- and low-side test pressures by checking the instructions in this manual and the pressures given on the unit name plate.

Do not use air for leak testing. Use only refrigerant or dry nitrogen.

Do not unweld or flame-cut the refrigerant lines or any refrigerant circuit component until all refrigerant (liquid and vapour) has been removed from chiller. Traces of vapour should be displaced with dry air nitrogen. Refrigerant in contact with an open flame produces toxic gases.

The necessary protection equipment must be available, and appropriate fire extinguishers for the system and the refrigerant type used must be within easy reach.

Do not siphon refrigerant.

Avoid contact with liquid refrigerant on the skin or splashing it into the eyes. Use safety goggles. Wash any spills from the skin with soap and water. If liquid refrigerant enters the eyes, immediately and abundantly flush the eyes with water and consult a doctor.

The accidental releases of the refrigerant, due to small leaks or significant discharges following the rupture of a pipe or an unexpected release from a relief valve, can cause frostbites and burns to personnel exposed. Do not ignore such injuries. Installers, owners and especially service engineers for these units must:

- *Seek medical attention before treating such injuries.*
- *Have access to a first-aid kit, especially for treating eye injuries.*

We recommend to apply standard EN 378-3 Annex 3.

Never apply an open flame or live steam to a refrigerant container. Dangerous overpressure can result. If it is necessary to heat refrigerant, use only warm water.

During refrigerant removal and storage operations follow applicable regulations. These regulations, permitting conditioning and recovery of halogenated hydrocarbons under optimum quality conditions for the products and optimum safety conditions for people, property and the environment are described in standard NF E29-795.

Any refrigerant transfer and recovery operations must be carried out using a transfer unit. A 3/8" SAE connector on the manual liquid line valve is supplied with all units for connection to the transfer station. The units must never be modified to add refrigerant and oil charging, removal and purging devices. All these devices are provided with the units. Please refer to the certified dimensional drawings for the units. Do not re-use disposable (non-returnable) cylinders or attempt to refill them. It is dangerous and illegal. When cylinders are empty, evacuate the remaining gas pressure, and move the cylinders to a place designated for their recovery. Do not incinerate.

ATTENTION: *Only use refrigerant R134a, in accordance with 700 AHRI (Air conditioning, Heating and Refrigeration Institute). The use of any other refrigerant may expose users and operators to unexpected risks.*

Do not attempt to remove refrigerant circuit components or fittings, while the machine is under pressure or while it is running. Be sure pressure is at 0 kPa before removing components or opening a circuit.

Do not attempt to repair or recondition any safety devices when corrosion or build-up of foreign material (rust, dirt, scale, etc.) is found within the valve body or mechanism. If necessary, replace the device. Do not install relief valves in series or backwards.

ATTENTION: No part of the unit must be used as a walk-way, rack or support. Periodically check and repair or if necessary replace any component or piping that shows signs of damage.

The refrigerant lines can break under the weight and release refrigerant, causing personal injury.

Do not climb on a machine. Use a platform, or staging to work at higher levels.

Use mechanical lifting equipment (crane, hoist, winch, etc.) to lift or move heavy components. For lighter components, use lifting equipment when there is a risk of slipping or losing your balance.

Use only original replacement parts for any repair or component replacement. Consult the list of replacement parts that corresponds to the specification of the original equipment.

Do not drain water circuits containing industrial brines, without informing the technical service department at the installation site or a competent body first.

Close the entering and leaving water shutoff valves and purge the unit water circuit, before working on the components installed on the circuit (screen filter, pump, water flow switch, etc.).

Do not loosen the water box bolts until the water boxes have been completely drained.

Periodically inspect all valves, fittings and pipes of the refrigerant and hydronic circuits to ensure that they do not show any corrosion or any signs of leaks.

It is recommended to wear ear defenders, when working near the unit and the unit is in operation.

2 - PRELIMINARY CHECKS

2.1 - Check equipment received

- Inspect the unit for damage or missing parts. If damage is detected, or if shipment is incomplete, immediately file a claim with the shipping company.
- Confirm that the unit received is the one ordered. Compare the name plate data with the order.
- The unit name plate must include the following information:
 - Version number
 - Model number
 - CE marking
 - Serial number
 - Year of manufacture and test date
 - Fluid being transported
 - Refrigerant used and refrigerant class
 - Refrigerant charge per circuit
 - Containment fluid to be used
 - PS: Min./max. allowable pressure (high and low pressure side)
 - TS: Min./max. allowable temperature (high and low pressure side)
 - Pressure switch cut-out pressures
 - Unit leak test pressure
 - Voltage, frequency, number of phases
 - Maximum current drawn
 - Maximum power input
 - Unit net weight
- Confirm that all accessories ordered for on-site installation have been delivered, and are complete and undamaged.

The unit must be checked periodically during its whole operating life to ensure that no shocks (handling accessories, tools etc.) have damaged it. If necessary, the damaged parts must be repaired or replaced. See also chapter 13 “Standard maintenance”.

2.2 - Moving and siting the unit

2.2.1 - Moving

See chapter 1.1 “Installation safety considerations”.

CAUTION: Only use slings at the designated lifting points which are marked on the unit.

2.2.2 - Siting the unit

Always refer to the chapter “Dimensions and clearances” to confirm that there is adequate space for all connections and service operations. For the centre of gravity coordinates, the position of the unit mounting holes, and the weight distribution points, refer to the certified dimensional drawing supplied with the unit.

Typical applications of these units are in refrigeration systems, and they do not require earthquake resistance. Earthquake resistance has not been verified.

Before siting the unit check that:

- the permitted loading at the site is adequate or that appropriate strengthening measures have been taken.
- the unit is installed level on an even surface (maximum tolerance is 5 mm in both axes).
- there is adequate space above the unit for air flow and to ensure access to the components.
- the number of support points is adequate and that they are in the right places.
- the location is not subject to flooding.

CAUTION: Lift and set down the unit with great care. Tilting and jarring can damage the unit and impair unit operation.

2.2.3 - Checks before system start-up

Before the start-up of the refrigeration system, the complete installation, including the refrigeration system must be verified against the installation drawings, dimensional drawings, system piping and instrumentation diagrams and the wiring diagrams.



During the installation test national regulations must be followed. If no national regulation exists, standard EN 378 can be used as a guide.

External visual installation checks:

- Ensure that the machine is charged with refrigerant. Verify on the unit nameplate that the ‘fluid being transported’ is R-134a and is not nitrogen.
- Compare the complete installation with the refrigeration system and power circuit diagrams.
- Check that all components comply with the design specifications.
- Check that all protection documents and equipment provided by the manufacturer (dimensional drawings, P&ID, declarations etc.) to comply with the regulations are present.
- Verify that the environmental safety and protection and devices and arrangements provided by the manufacturer to comply with the regulations are in place.
- Verify that all document for pressure containers, certificates, name plates, files, instruction manuals provided by the manufacturer to comply with the regulations are present.
- Verify the free passage of access and safety routes.
- Check that ventilation in the plant room is adequate.
- Check that refrigerant detectors are present.
- Verify the instructions and directives to prevent the deliberate removal of refrigerant gases that are harmful to the environment.
- Verify the installation of connections.
- Verify the supports and fixing elements (materials, routing and connection).
- Verify the quality of welds and other joints.
- Check the protection against mechanical damage.
- Check the protection against heat.
- Check the protection of moving parts.
- Verify the accessibility for maintenance or repair and to check the piping.
- Verify the status of the valves.
- Verify the quality of the thermal insulation and of the vapour barriers.

3 - DIMENSIONS, CLEARANCES

3.1 - 30XW--/30XWH- 254-852 – 30XW-P/30XWHP 512-862

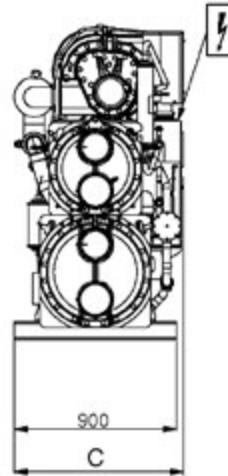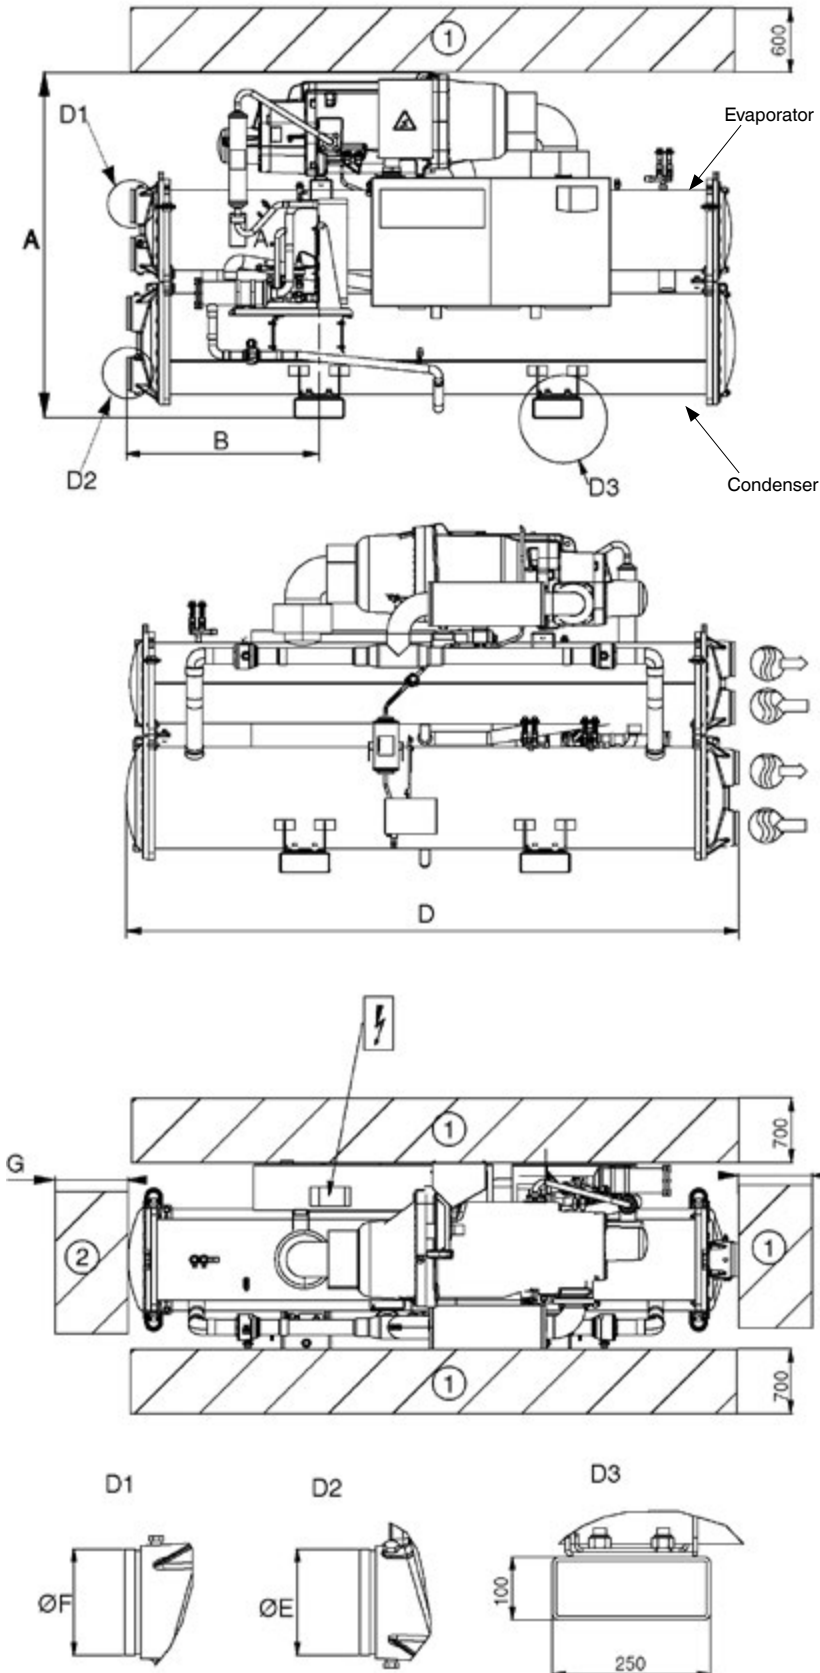

Dimensions in mm							
	A	B	C	D	E	F	G
Standard-efficiency units 30XW--/30XWH-							
254	1567	800	928	2724	141.3	141.3	2600
304	1567	800	928	2724	141.3	141.3	2600
354	1567	800	928	2724	141.3	141.3	2600
402	1693	810	936	2742	141.3	141.3	2600
452	1693	810	936	2742	141.3	141.3	2600
552	1693	810	936	2742	141.3	141.3	2600
602	1693	810	936	2742	141.3	141.3	2600
652	1848	968	1044	3059	168.3	168.3	2800
702	1848	968	1044	3059	168.3	168.3	2800
802	1848	968	1044	3059	168.3	168.3	2800
852	1898	828	1044	2780	219.1	168.3	2600
High-efficiency units 30XW-P/30XWHP							
512	1743	968	936	3059	168.3	168.3	2800
562	1743	968	936	3059	168.3	168.3	2800
712	1950	1083	1065	3290	219.1	219.1	3100
812	1950	1083	1070	3290	219.1	219.1	3100
862	1950	1083	1070	3290	219.1	219.1	3100
Standard-efficiency units 30XW--/30XWH- (option 150)							
254	1567	800	928	2724	141.3	141.3	2600
304	1567	800	928	2724	141.3	141.3	2600
354	1567	800	928	2724	141.3	141.3	2600
402	1693	810	936	2742	141.3	141.3	2600
452	1693	810	936	2742	141.3	141.3	2600
552	1693	810	936	2742	141.3	141.3	2600
602	1693	810	936	2742	141.3	141.3	2600
652	1868	968	1090	3059	168.3	168.3	2800
702	1868	968	1090	3059	168.3	168.3	2800
802	1868	968	1090	3059	168.3	168.3	2800
852	1920	828	1090	2780	168.3	219.1	2600
High-efficiency units 30XW-P/30XWHP (option 150)							
512	1743	968	936	3059	168.3	168.3	2800
562	1743	968	936	3059	168.3	168.3	2800
712	1970	1083	1105	3290	219.1	219.1	3100
812	1970	1083	1105	3290	219.1	219.1	3100
862	1970	1083	1105	3290	219.1	219.1	3100

Legend:


All dimensions are given in mm.

- ① Required clearances for maintenance
- ② Recommended space for tube removal
- Water inlet
- Water outlet
- Power supply connection

NOTES:




- Drawings are not contractually binding. Before designing an installation, consult the certified dimensional drawings supplied with the unit or available on request.
- For the positioning of the fixing points, weight distribution and centre of gravity coordinates please refer to the dimensional drawings.

3.2 - 30XW--/30XWH- 1002-1552 – 30XW-P/30XWHP 1012-1464

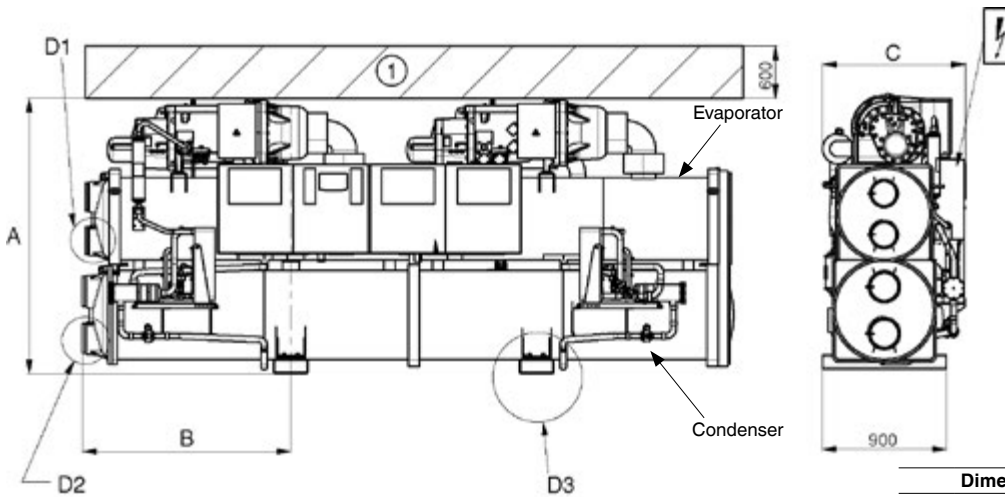

Dimensions in mm

	A	B	C	D	E	F	G
Standard-efficiency units 30XW--/30XWH-							
1002	1870	950	1036	4025	219.1	168.3	3800
1052	1870	950	1036	4025	219.1	168.3	3800
1152	1925	950	1036	4025	219.1	219.1	3800
1252	2051	1512	1162	4730	219.1	219.1	4500
1352	2051	1512	1162	4730	219.1	219.1	4500
1452	2051	1512	1162	4730	219.1	219.1	4500
1552	2051	1512	1162	4730	219.1	219.1	4500
High-efficiency units 30XW-P/30XWHP							
1012	1997	1512	1039	4730	219.1	219.1	4500
1162	1997	1512	1039	4730	219.1	219.1	4500
1314	2051	1512	1162	4730	219.1	219.1	4500
1464	2051	1512	1162	4730	219.1	219.1	4500
Standard-efficiency units 30XW--/30XWH- (option 150)							
1002	1870	950	1036	4025	219.1	168.3	3800
1052	1870	950	1036	4025	219.1	168.3	3800
1154	2925	950	1036	4025	219.1	219.1	3800
1252	2071	1512	1202	4730	219.1	219.1	4500
1352	2071	1512	1202	4730	219.1	219.1	4500
1452	2071	1512	1202	4730	219.1	219.1	4500
1552	2071	1512	1202	4730	219.1	219.1	4500
High-efficiency units 30XW-P/30XWHP (option 150)							
1012	1997	1512	1039	4730	219.1	219.1	4500
1162	1997	1512	1039	4730	219.1	219.1	4500
1314	2071	1512	1202	4730	219.1	219.1	4500
1464	2071	1512	1202	4730	219.1	219.1	4500

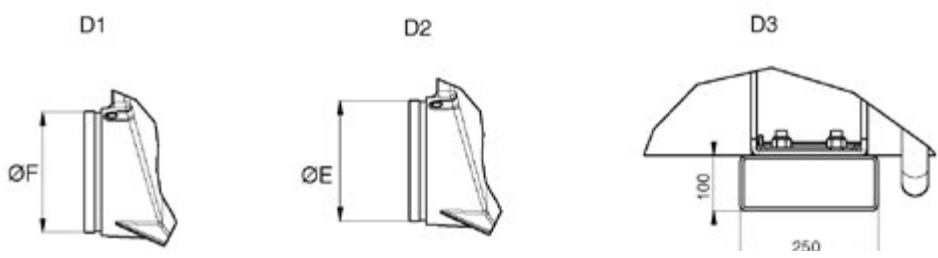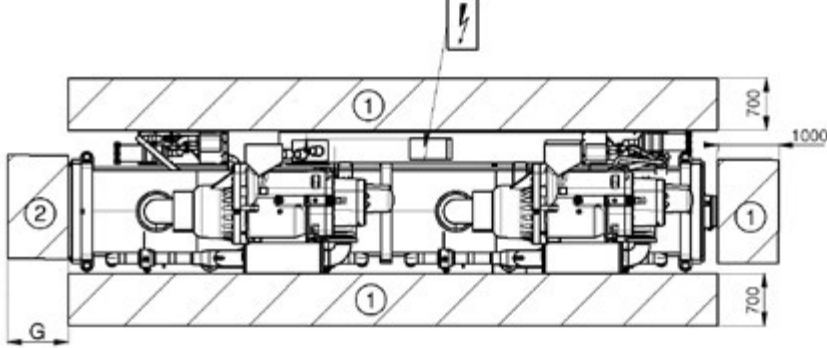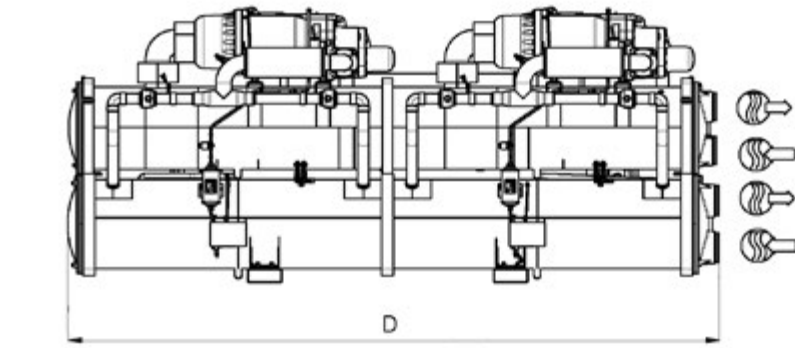


NOTES:

- Drawings are not contractually binding. Before designing an installation, consult the certified dimensional drawings supplied with the unit or available on request.
- For the positioning of the fixing points, weight distribution and centre of gravity coordinates please refer to the dimensional drawings.

Legend:
All dimensions are given in mm.

- ① Required clearances for maintenance
- ② Recommended space for tube removal
- ⊕ Water inlet
- ⊖ Water outlet
- ⚡ Power supply connection

3.3 - 30XW--/30XWH- 1652-1702 – 30XW-P/30XWHP 1612-1762

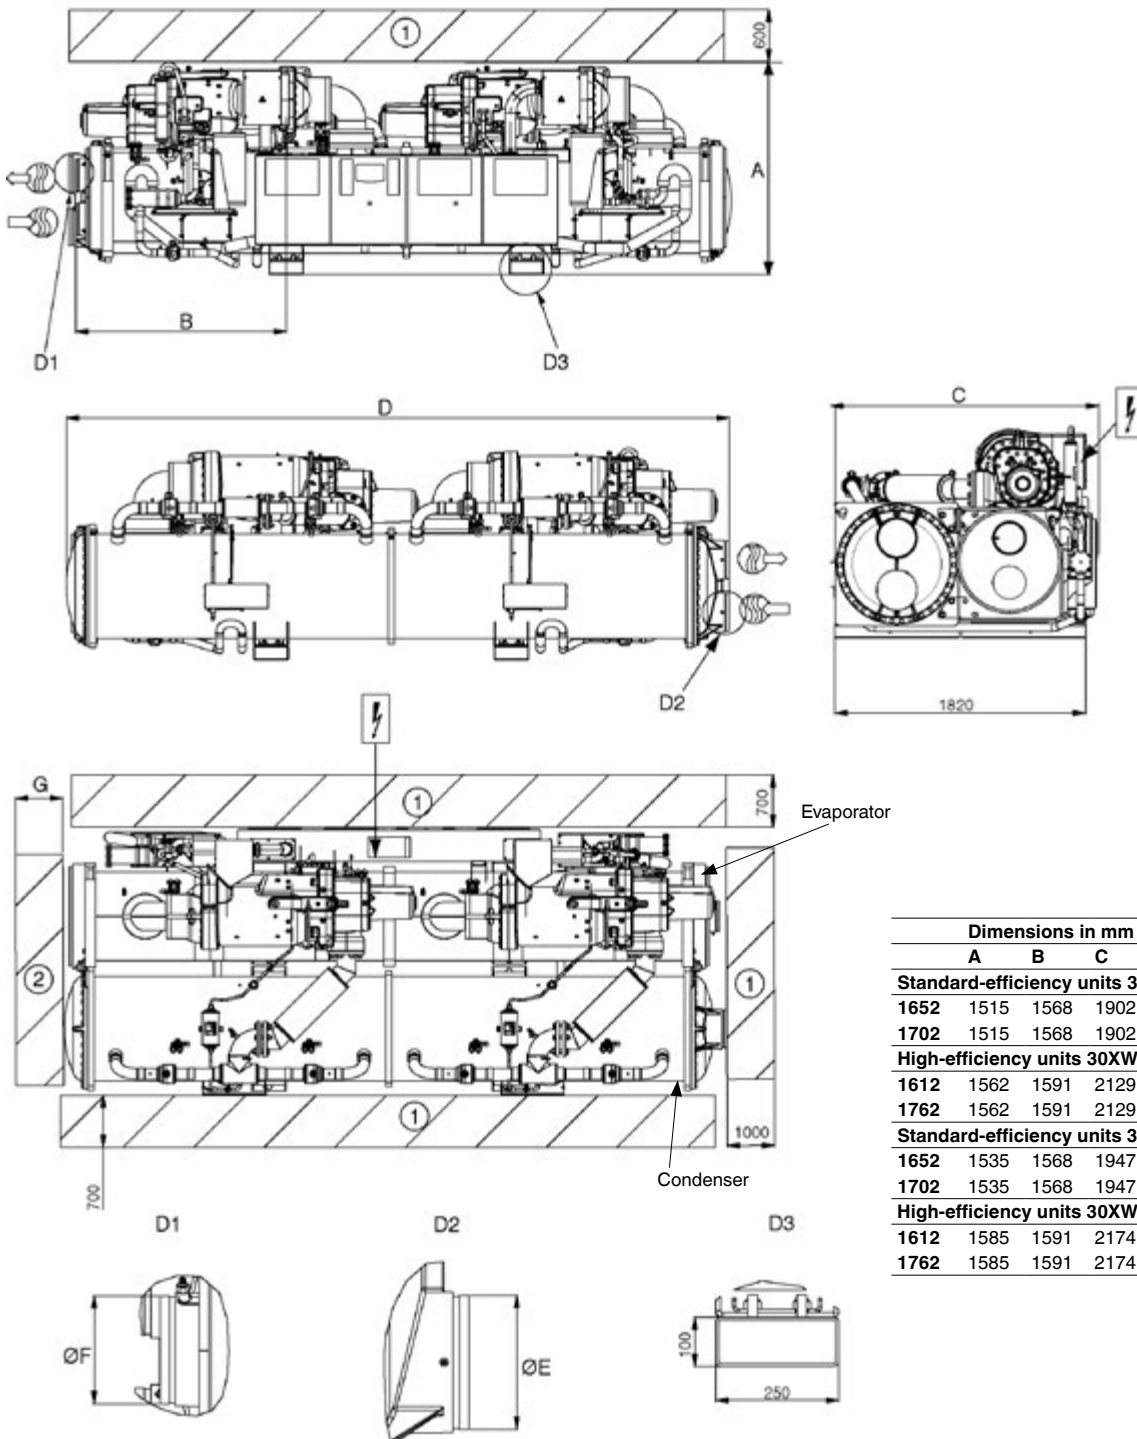

Dimensions in mm							
	A	B	C	D	E	F	G
Standard-efficiency units 30XW--/30XWH-							
1652	1515	1568	1902	4790	219.1	219.1	4500
1702	1515	1568	1902	4790	219.1	219.1	4500
High-efficiency units 30XW-P/30XWHP							
1612	1562	1591	2129	4832	273.1	273.1	4600
1762	1562	1591	2129	4832	273.1	273.1	4600
Standard-efficiency units 30XW--/30XWH- (option 150)							
1652	1535	1568	1947	4790	219.1	219.1	4500
1702	1535	1568	1947	4790	219.1	219.1	4500
High-efficiency units 30XW-P/30XWHP (option 150)							
1612	1585	1591	2174	4832	273.1	273.1	4600
1762	1585	1591	2174	4832	273.1	273.1	4600

NOTES:

- Drawings are not contractually binding. Before designing an installation, consult the certified dimensional drawings supplied with the unit or available on request.
- For the positioning of the fixing points, weight distribution and centre of gravity coordinates please refer to the dimensional drawings.

Legend:

All dimensions are given in mm.

- ① Required clearances for maintenance
- ② Recommended space for tube removal
- Water inlet
- Water outlet
- Power supply connection

4.3 - Short-circuit stability current for all units

Short-circuit stability current for all units using the TN system (earthing system type): 50 kA (conditional system short-circuit current I_{cc}/I_{cf} at the unit connection point as rms value).

All units are equipped with protection fuses located in the control box immediately downstream from the unit connection point.

4.4 - Compressor electrical data 30XW

Compressor	I Nom (A)*	I Max (A)**	I Max (A)** Option 150B	MHA (A)	LRYA (A)	LRDA (A)	Cosine phi nom.*	Cosine phi max.**
06TTW266	84	123	109	138	233	725	0.83	0.89
06TTW301	96	145	129	162	233	725	0.85	0.89
06TTW356	113	160	142	178	303	945	0.83	0.88
06TUW483	144	217	191	230	414	1290	0.88	0.90
06TUW554	162	242	212	260	414	1290	0.89	0.90
06TVW680	193	295	278	304	587	1828	0.88	0.90
06TVW753	214	317	290	340	587	1828	0.89	0.91
06TVW819	232	351	325	358	587	1828	0.90	0.91
06TTA266	95	160	125	176	303	945	0.79	0.88
06TTA301	109	185	144	206	388	1210	0.78	0.87
06TTA356	125	200	156	224	388	1210	0.81	0.88
06TUA483	162	275	215	300	587	1828	0.85	0.91
06TUA554	171	300	234	330	587	1828	0.85	0.91
06TVA680	210	400	312	419	772	2315	0.85	0.91
06TVA753	230	430	335	455	772	2315	0.86	0.91
06TVA819	250	460	359	476	772	2315	0.87	0.91

* Value at standard Eurovent conditions: evaporator entering/leaving water temperature = 12°C/7°C, condenser entering/leaving water temperature = 30°C/35°C.
 ** Value at maximum capacity and nominal voltage (400 V)

Legend

MHA - Maximum compressor operating current, limited by the unit (current given for maximum capacity at 360 V)
LRYA - Locked rotor current for star connection (connection during compressor start-up)
LRDA - Locked rotor current for delta connection

4.5 - Compressor usage per circuit (A, B)

30XW	254	304	354	402	552	652	702	802	1002	1012	1052	1252	1352	1452	1552	1652
				452	562	712	812	852			1154	1314	1464	1612	1702	
				512	602			862			1162				1762	
Units without option 150																
06TTW266	A	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
06TTW301	-	A	-	-	-	-	-	-	-	-	-	-	-	-	-	-
06TTW356	-	-	A	-	-	-	-	-	-	-	-	-	-	-	-	-
06TUW483	-	-	-	A	-	-	-	-	B	AB	-	-	-	-	-	-
06TUW554	-	-	-	-	A	-	-	-	A	-	AB	B	-	-	-	-
06TVW680	-	-	-	-	-	A	-	-	-	-	-	A	AB	-	-	-
06TVW753	-	-	-	-	-	-	A	-	-	-	-	-	-	AB	-	B
06TVW819	-	-	-	-	-	-	-	A	-	-	-	-	-	-	AB	A
Units with option 150																
06TTA266	A	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
06TTA301	-	A	-	-	-	-	-	-	-	-	-	-	-	-	-	-
06TTA356	-	-	A	-	-	-	-	-	-	-	-	-	-	-	-	-
06TUA483	-	-	-	A	-	-	-	-	B	AB	-	-	-	-	-	-
06TUA554	-	-	-	-	A	-	-	-	A	-	AB	B	-	-	-	-
06TVA680	-	-	-	-	-	A	-	-	-	-	-	A	AB	-	-	-
06TVA753	-	-	-	-	-	-	A	-	-	-	-	-	-	AB	-	B
06TVA819	-	-	-	-	-	-	-	A	-	-	-	-	-	-	AB	A

Electrical data notes and operating conditions, 30XW units

- As standard:
30XW 254 to 862 units have a single power connection point located immediately upstream of the main disconnect switch.
30XW 1002 to 1762 units have two connection points located immediately upstream of the main disconnect switches.
- The control box includes the following standard features:
 - One main disconnect switch per circuit*
 - Starter and motor protection devices for each compressor
 - Anti-short cycle protection devices*
 - Control devices
- Field connections:
All connections to the system and the electrical installations must be in full accordance with all applicable codes.
- The Carrier 30XW units are designed and built to ensure conformance with local codes. The recommendations of European standard EN 60204-1 (corresponds to IEC 60204-1) (machine safety - electrical machine components - part 1: general regulations) are specifically taken into account, when designing the electrical equipment.
- The absence of power supply disconnect switch(es) and short-cycle protection devices in option 82A is an important factor that has to be taken into consideration at the installation site.
Units equipped with one of these two options are supplied with a declaration of incorporation, as required by the machinery directive.

Notes:

- Generally the recommendations of IEC 60364 are accepted as compliance with the requirements of the installation directives. Conformance with EN 60204-1 is the best means of ensuring compliance with the Machines Directive.
- Annex B of EN 60204 1 describes the electrical characteristics used for the operation of the machines.

- The operating environment for the 30XW units is specified below:
 - Environment** Environment as classified in EN 60721 (corresponds to IEC 60721):
 - indoor installation
 - ambient temperature range: minimum temperature +5°C to +42°C, class AA4
 - altitude: lower than or equal to 2000 m
 - presence of water: class AD2 (possibility of water droplets)
 - presence of hard solids, class 4S2 (no significant dust present)
 - presence of corrosive and polluting substances, class 4C2 (negligible)
- Power supply frequency variation: ± 2 Hz.
- The neutral (N) line must not be connected directly to the unit (if necessary use a transformer).
- Overcurrent protection of the power supply conductors is not provided with the unit.
- The factory installed disconnect switch(es)/circuit breaker(s) is (are) of a type suitable for power interruption in accordance with EN 60947-3 (corresponds to IEC 60947-3).
- The units are designed for connection to TN networks (IEC 60364). For IT networks the earth connection must not be at the network earth. Provide a local earth, consult competent local organisations to complete the electrical installation.

NOTE: If particular aspects of an actual installation do not conform to the conditions described above, or if there are other conditions which should be considered, always contact your local Carrier representative.

* Not provided for units equipped with option 82A

** The required protection level for this class is IP21B or IPX1B (according to reference standard IEC 60529). All 30XW units fulfil this protection condition. In general the casings fulfil class IP23 or IPX3E.

5 - ELECTRICAL CONNECTION

Please refer to the certified dimensional drawings, supplied with the unit.

5.1 - Power supply

The power supply must conform to the specification on the unit nameplate. The supply voltage must be within the range specified in the electrical data table. For connection details refer to the wiring diagrams.

WARNING: Operation of the unit with an improper supply voltage or excessive phase imbalance constitutes abuse which will invalidate the Carrier warranty. If the phase imbalance exceeds 2% for voltage, or 10% for current, contact your local electricity supplier at once and ensure that the unit is not switched on until corrective measures have been taken.

5.2 - Voltage phase imbalance (%)

$$\frac{100 \times \text{max. deviation from average voltage}}{\text{Average voltage}}$$

Example:

On a 400 V - 3 ph - 50 Hz supply, the individual phase voltages were measured to be:

AB = 406 V; BC = 399 V; AC = 394 V


$$\begin{aligned} \text{Average voltage} &= (406 + 399 + 394)/3 = 1199/3 \\ &= 399.7 \text{ say } 400 \text{ V} \end{aligned}$$

Calculate the maximum deviation from the 400 V average:

$$(AB) = 406 - 400 = 6$$

$$(BC) = 400 - 399 = 1$$

$$(CA) = 400 - 394 = 6$$



The maximum deviation from the average is 6 V. The greatest percentage deviation is: $100 \times 6/400 = 1.5 \%$. This is less than the permissible 2% and is therefore acceptable.

5.3 - Power connection/disconnect switch

Units	Connection points
30XW 252-862	1 per unit
30XW 1002-1762	1 for circuit A 1 for circuit B

5.4 - Recommended wire sections

Wire sizing is the responsibility of the installer, and depends on the characteristics and regulations applicable to each installation site. The following is only to be used as a guideline, and does not make in any way liable. After wire sizing has been completed, using the certified dimensional drawing, the installer must ensure easy connection and define any modifications necessary on site.

The connections provided as standard for the field-supplied power entry cables to the general disconnect/isolator switch are designed for the number and type of wires, listed in the second column of the table on the next page.

The calculations for favourable and unfavourable cases are based on the maximum current for each unit (see electrical data tables). The design uses the standardised installation methods in accordance with IEC 60364: multiconductor PVC (70°C) or XLPE (90°C) insulated cables with copper core; arrangement to comply with table 52c of the above standard. The maximum temperature is 42°C. The given maximum length is calculated to limit the voltage drop to 5%.

Minimum and maximum connectable wire sections for 30XW units

Connectable wire section*		Calculation favourable case: Perforated horizontal conduit (standardised routing No. 15) XLPE insulated cable			Calculation unfavourable case: Closed conduit (standardised routing No. 41) PVC insulated cable, if possible		
30XW - Circuit(s) A/(B)	Section mm ² (per phase)	Section** mm ² (per phase)	Max. length m	Cable type	Section** mm ² (per phase)	Max. length m	Cable type***
Units without option 150 or 81							
254 - 304	1 x 150	1 x 50	160	XLPE Cu	1 x 95	310	PVC Cu
354	1 x 240	1 x 70	220	XLPE Cu	1 x 95	350	PVC Cu
402	1 x 240	1 x 70	170	XLPE Cu	1 x 150	350	PVC Cu
452 - 512	1 x 240	1 x 95	230	XLPE Cu	1 x 185	390	PVC Cu
552 - 562 - 602	1 x 240	1 x 95	275	XLPE Cu	1 x 185	360	PVC Cu
652 - 712	1 x 240	1 x 120	210	XLPE Cu	1 x 240	380	PVC Cu
702 - 812	1 x 240	1 x 150	230	XLPE Cu	1 x 240	330	XLPE Cu
802 - 852 - 862	1 x 240	1 x 150	217	XLPE Cu	1 x 240	320	XLPE Cu
1002	2 x 240/2 x 240	1 x 95/1 x 95	200/200	XLPE Cu	1 x 240/1 x 240	400/400	PVC Cu
1012	2 x 240/2 x 240	1 x 120/1 x 95	230/200	XLPE Cu	1 x 240/1 x 240	400/401	PVC Cu
1052 - 1154 - 1162	2 x 240/2 x 240	1 x 120/1 x 120	220/220	XLPE Cu	2 x 120/2 x 120	375/375	PVC Cu
1252 - 1314	2 x 240/2 x 240	1 x 150/1 x 120	220/220	XLPE Cu	2 x 185/2 x 120	410/375	PVC Cu
1352 - 1464	2 x 240/2 x 240	1 x 150/1 x 150	220/220	XLPE Cu	2 x 185/2 x 185	410/410	PVC Cu
1452 - 1612	2 x 240/2 x 240	1 x 185/1 x 185	230/230	XLPE Cu	2 x 185/2 x 185	370/370	PVC Cu
1552 - 1702 - 1762	2 x 240/2 x 240	1 x 185/1 x 185	220/220	XLPE Cu	2 x 240/2 x 240	400/400	PVC Cu
1652	2 x 240/2 x 240	1 x 185/1 x 185	220/230	XLPE Cu	2 x 240/2 x 185	400/400	PVC Cu
Units with option 150							
254 - 304	1 x 240	1 x 70	190	XLPE Cu	1 x 150	370	PVC Cu
354	1 x 240	1 x 70	170	XLPE Cu	1 x 185	400	PVC Cu
402	1 x 240	1 x 95	190	XLPE Cu	1 x 240	420	PVC Cu
452 - 512	1 x 240	1 x 120	210	XLPE Cu	1 x 185	290	PVC Cu
552 - 562 - 602	1 x 240	1 x 120	210	XLPE Cu	1 x 240	340	XLPE Cu
652 - 712	2 x 240	1 x 240	275	XLPE Cu	2 x 150	320	XLPE Cu
702 - 812	2 x 240	1 x 240	250	XLPE Cu	2 x 150	300	XLPE Cu
802 - 852 - 862	2 x 240	2 x 240	240	XLPE Cu	2 x 150	280	XLPE Cu
1002	2 x 240/2 x 240	1 x 150/1 x 150	220/230	XLPE Cu	2 x 150/2 x 150	310/340	PVC Cu
1012	2 x 240/2 x 240	1 x 150/1 x 150	220/220	XLPE Cu	2 x 185/2 x 185	410/410	XLPE Cu
1052 - 1154 - 1162	2 x 240/2 x 240	1 x 150/1 x 150	210/210	XLPE Cu	2 x 185/2 x 185	400/400	PVC Cu
1252 - 1314	2 x 240/2 x 240	1 x 240/1 x 150	240/210	XLPE Cu	2 x 185/2 x 185	310/400	XLPE Cu /PVC Cu
1352 - 1464	2 x 240/2 x 240	1 x 240/1 x 240	240/240	XLPE Cu	2 x 185/2 x 185	310/310	XLPE Cu
1452 - 1612	2 x 240/2 x 240	2 x 120/2 x 120	220/220	XLPE Cu	2 x 240/2 x 185	320/310	XLPE Cu
1552 - 1652 - 1702 - 1762	2 x 240/2 x 240	2 x 120/2 x 120	210/210	XLPE Cu	2 x 240/2 x 240	320/320	XLPE Cu
Units with option 81							
1002 to 1162	4 x 240	2 x 150	220	XLPE Cu	4 x 120	375	PVC Cu
1252 to 1762	4 x 240	4 x 120	210	XLPE Cu	4 x 240	400/400	PVC Cu
Units with options 81 and 150							
1002 to 1162	4 x 240	2 x 185	220	XLPE Cu	4 x 150	310	XLPE Cu
1252 to 1762	5 x 240	4 x 120	210	XLPE Cu	4 x 240	320	XLPE Cu

* Connection capacities actually available for each machine, defined according to the connection terminal size, the control box access opening size and the available space inside the control box.

** Selection simulation result considering the hypothesis indicated.

*** If the maximum calculated section is for an XLPE cable type, this means that a selection based on a PVC cable type can exceed the connection capacity actually available. Special attention must be given to the selection.

Note: The currents considered are given for a machine equipped with a hydronic kit operating at maximum current.

5.5 - Power cable entry

The power cables can enter the 30XW control box from above the unit. A removable aluminium plate on the upper part of the control box face allows introduction of the cables. Refer to the certified dimensional drawing for the unit.

5.6 - Field control wiring

IMPORTANT: Field connection of interface circuits may lead to safety risks: any control box modification must maintain equipment conformity with local regulations. Precautions must be taken to prevent accidental electrical contact between circuits supplied by different sources:

- **The routing selection and/or conductor insulation characteristics must ensure dual electric insulation.**
- **In case of accidental disconnection, conductor fixing between different conductors and/or in the control box prevents any contact between the conductor ends and an active energised part.**

Refer to the 30XA/30XW Pro-Dialog Control manual and the certified wiring diagram supplied with the unit for the field control wiring of the following features:

- Remote on/off switch
- Demand limit external switch
- Remote dual set point
- Alarm, alert and operation report
- Evaporator pump control
- Heat reclaim condenser pump control (option)
- Hot water valve control (option)
- Various interlocks on the Energy Management Module (EMM) board (accessory or option)

CCN bus connection

- The permanent connection to the system CCN bus is made at the terminal provided for this purpose inside the control box.
- The connection of the CCN service tool is possible at a socket under the control box, accessible from outside.

5.7 - 24 and 230 V power reserve for the user

Control circuit reserve:

After all required options have been connected, the TC transformer includes a power reserve that can be used for the field control wiring:

- Unit without option 084* 2 A (24 V a.c.) or 48 VA
 - Unit with option 084* 1.3 A (24 V a.c.) or 30 VA
- * 084 or 084R or 084D

At this TC transformer the 230 V, 50 Hz circuit allows the supply of a battery charger for a portable computer at 0.8 A maximum at 230 V. The connection is via an EEC 7/16 type socket (2 poles without earth) located under the control box and accessible from outside. Only devices with class II double insulation can be connected at this socket.

6 - APPLICATION DATA

6.1 - Operating limits for 30XW units


30XW--/30XW-P	Minimum	Maximum
Evaporator		
Entering temperature at start-up	-	35.0°C
Leaving temperature during operation	3.3°C*	20.0°C
Entering/leaving temperature difference at full load	2.8 K	11.1 K
Condenser		
Entering temperature at start-up	13.0°C**	-
Leaving temperature during operation	19.0°C**	50.0°C***
Entering/leaving temperature difference at full load	2.8 K	11.1 K

* For low-temperature applications, where the leaving water temperature is below 3.3°C, a frost protection solution must be used. Please refer to option 5 and option 6.

** For lower condenser temperatures a water flow control valve must be used at the condenser (two or three-way valve). Please refer to option 152 to ensure the correct condensing temperature.

*** Please refer to option 150 for applications with a high condenser leaving temperature (up to 63°C).

Note: Ambient temperatures: These units are dedicated for indoor environment. The external temperature at chiller start up should be at least 5°C. For such low ambient, option 152 is recommended. During storage and transport of the 30XW units (including by container) the minimum and maximum permissible temperatures are -20°C and 72°C (and 65°C for option 200).

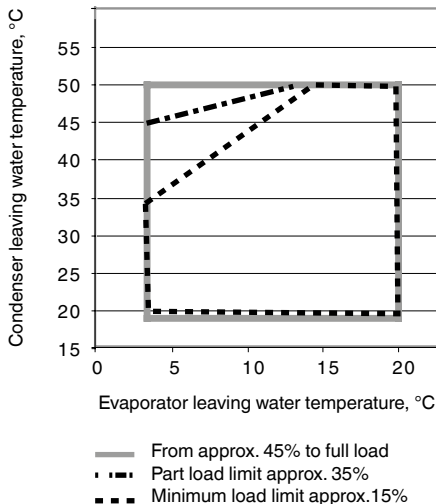


For more precise details refer to the unit selection program.

6.2 - Minimum chilled water flow

The minimum chilled water flow is shown in the table in chapter 6.6.

If the system flow is less than the minimum unit flow rate, the evaporator flow can be recirculated, as shown in the diagram.

For minimum chilled water flow rate

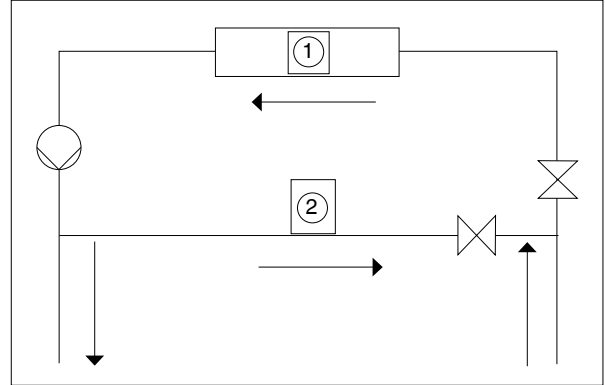

Legend


- 1. Evaporator
- 2. Recirculation

6.3 - Maximum chilled water flow

The maximum chilled water flow is limited by the permitted pressure drop in the evaporator. It is provided in the table in chapter 6.6.

- Select the option with one water pass less that will allow a higher maximum water flow rate (see option 100C in the table in chapter 6.5).
- Bypass the evaporator as shown in the diagram to obtain a lower evaporator flow rate.

For maximum chilled water flow rate

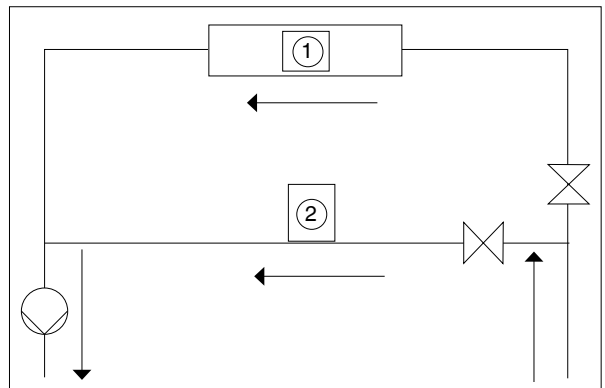

Legend

- 1. Evaporator
- 2. Bypass

6.4 - Condenser water flow rate

The minimum and maximum condenser water flow rates are shown in the table in chapter 6.6.

If the system flow is higher than the maximum unit flow rate, select the option with one pass less that will allow a higher maximum water flow rate. Please refer to option 102C in the table in chapter 6.5.

6.5 - Standard and optional number of water passes

Standard-efficiency units 30XW--																				
Size	254	304	354	402	452	552	602	652	702	802	852	1002	1052	1154	1252	1352	1452	1552	1652	1702
Evaporator																				
Standard	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2
Option 100C	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
Condenser																				
Standard	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2
Option 102C	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1

High-efficiency units 30XW-P											
Size	512	562	712	812	862	1012	1162	1314	1464	1612	1762
Evaporator											
Standard	2	2	2	2	2	2	2	2	2	2	2
Option 100C	1	1	1	1	1	1	1	1	1	1	1
Condenser											
Standard	2	2	2	2	2	2	2	2	2	2	2
Option 102C	1	1	1	1	1	1	1	1	1	1	1

6.6 - Evaporator and condenser water flow rates

These below values are given for standard units. For options 100C and 102C, please refer to the unit selection program.

Standard-efficiency units 30XW--																				
Size	254	304	354	402	452	552	602	652	702	802	852	1002	1052	1154	1252	1352	1452	1552	1652	1702
Evaporator water flow rate, l/s																				
Minimum	6	6	6	7	7	7	7	9	9	9	9	13	13	15	18	18	18	18	22	22
Maximum	39	39	39	39	43	43	43	57	57	57	61	67	67	78	84	84	84	84	116	116
Condenser water flow rate, l/s																				
Minimum	4	4	4	4	4	4	4	6	6	6	8	8	8	9	12	12	12	12	14	14
Maximum	29	29	29	29	47	47	47	55	55	55	82	82	82	109	119	119	119	119	134	134

High-efficiency units 30XW-P											
Size	512	562	712	812	862	1012	1162	1314	1464	1612	1762
Evaporator water flow rate, l/s											
Minimum	10	10	13	13	13	18	18	22	22	28	28
Maximum	57	57	76	76	76	84	84	116	116	121	121
Condenser water flow rate, l/s											
Minimum	6	6	8	8	8	12	12	18	18	22	22
Maximum	55	55	74	74	74	119	119	130	130	149	149

Notes

- Minimum evaporator flow rate based on a water velocity of 0,5 m/s.
- Minimum condenser flow rate based on a water velocity of 0,3 m/s.
- Maximum flow rate based on a pressure drop of 120 kPa (units with two evaporator passes and two condenser passes).

6.7 - Variable flow evaporator

Variable evaporator flow can be used. The controlled flow rate must be higher than the minimum flow given in the table of permissible flow rates and must not vary by more than 10% per minute.

If the flow rate changes more rapidly, the system should contain a minimum of 6.5 litres of water per kW instead of 3.25 l/kW.

6.8 - System minimum water volume

Whichever the system, the water loop minimum volume is given by the formula: $\text{Volume} = \text{Cap (kW)} \times \text{N litres}$


Application	N
Normal air conditioning	3.25
Process type cooling	6.5

Where Cap is the nominal system cooling capacity (kW) at the nominal operating conditions of the installation.

This volume is necessary for stable operation.


It is often necessary to add a buffer water tank to the circuit in order to achieve the required volume. The tank must itself be internally baffled in order to ensure proper mixing of the liquid (water or brine). Refer to the examples below.

Connection to a buffer tank

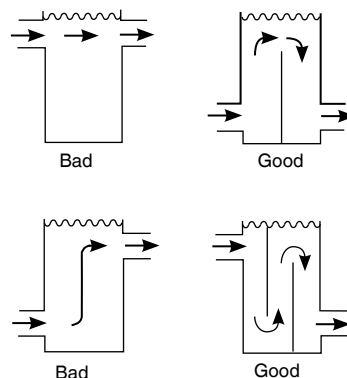

6.9 - Evaporator pressure drop curves


**Units with two evaporator passes (standard):
30XW--/30XWH-/30XW-P/30XWHP**

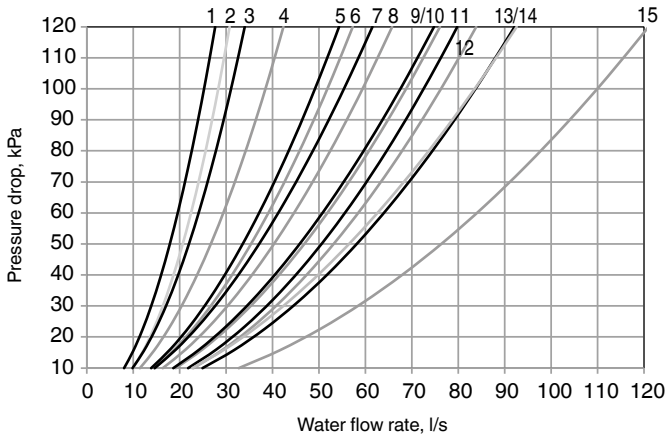

Legend

1. 254
2. 304
3. 354
4. 402, 452, 552, 602
5. 512, 562
6. 652, 702, 802
7. 852
8. 1002, 1052
9. 1154
10. 712, 812, 862
11. 1012, 1162
12. 1252, 1352, 1452, 1552
13. 1314, 1464
14. 1652, 1702
15. 1612, 1762

**Units with one evaporator pass (option 100C):
30XW--/30XWH-/30XW-P/30XWHP**

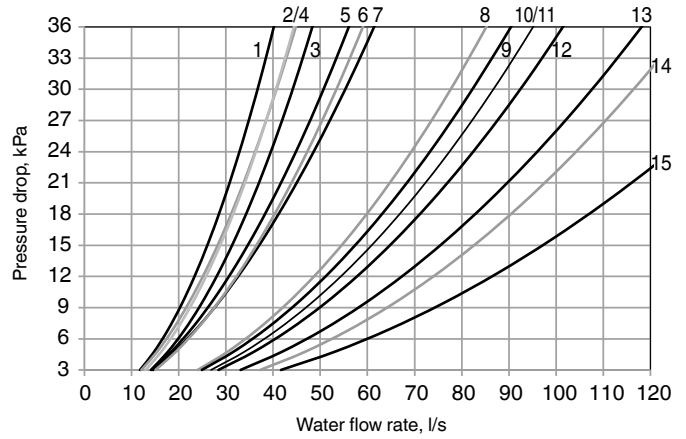


Legend

1. 254
2. 304
3. 354
4. 402, 452, 552, 602
5. 512, 562
6. 652, 702, 802
7. 852
8. 1002, 1052
9. 1012, 1162
10. 712, 812, 862
11. 1252, 1352, 1452, 1552
12. 1154
13. 1314, 1464
14. 1652, 1702
15. 1612, 1762

6.10 - Condenser pressure drop curves


**Units with two condenser passes (standard):
30XW--/30XWH-/30XW-P/30XWHP**

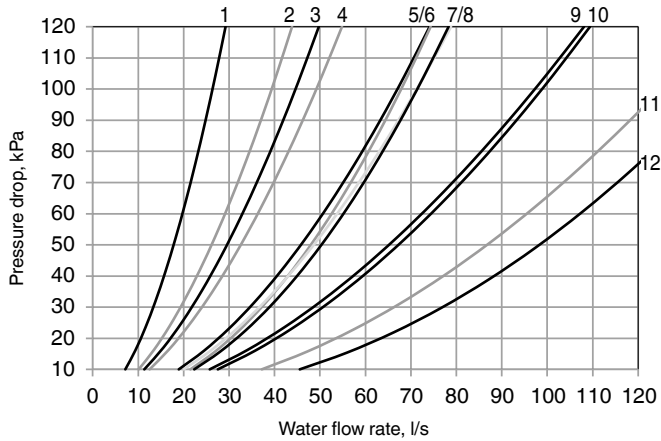

Legend

1. 254, 304, 354
2. 402, 452, 552, 602
3. 512, 562
4. 652, 702, 802
5. 712, 812, 862
6. 852
7. 1154
8. 1002, 1052
9. 1012, 1162
10. 1252, 1352, 1452, 1552, 1314, 1464
11. 1652, 1702
12. 1612, 1762

**Units with one condenser pass (option 102C):
30XW--/30XWH-/30XW-P/30XWHP**

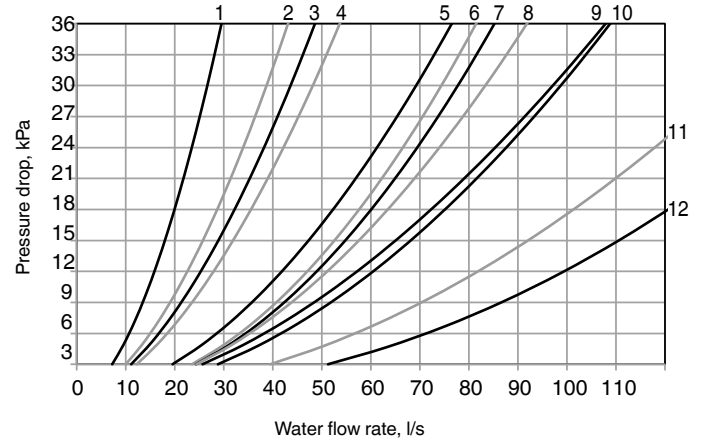

Legend

1. 254, 304, 354
2. 402, 452, 552, 602
3. 512, 562
4. 652, 702, 802
5. 712, 812, 862
6. 852
7. 1002, 1052
8. 1154
9. 1012, 1162
10. 1252, 1352, 1452, 1552, 1314, 1464
11. 1652, 1702
12. 1612, 1762

7 - WATER CONNECTIONS

ATTENTION: Before carrying out any water connections install the water box purge plugs (one plug per water box in the lower section - supplied in the control box).

For size and position of the heat exchanger water inlet and outlet connections refer to the certified dimensional drawings supplied with the unit.

The water pipes must not transmit any radial or axial force to the heat exchangers nor any vibration.

The water supply must be analysed and appropriate filtering, treatment, control devices, isolation and bleed valves and circuits built in, to prevent corrosion, fouling and deterioration of the pump fittings. Consult either a water treatment specialist or appropriate literature on the subject.

7.1 - Operating precautions

The water circuit should be designed to have the least number of elbows and horizontal pipe runs at different levels. Below the main points to be checked for the connection:

- Comply with the water inlet and outlet connections shown on the unit.
- Install manual or automatic air purge valves at all high points in the circuit(s).
- Use a pressure reducer to maintain pressure in the circuit(s) and install a safety valve as well as an expansion tank.
- Install thermometers in both the entering and leaving water connections.
- Install drain connections at all low points to allow the whole circuit to be drained.
- Install stop valves, close to the entering and leaving water connections.
- Use flexible connections to reduce the transmission of vibrations.
- Insulate all pipework, after testing for leaks, both to reduce heat gains and to prevent condensation.
- Cover the insulation with a vapour barrier.
- Where there are particles in the fluid that could foul the heat exchanger, a screen filter should be installed ahead of the pump. The mesh size of the filter must be 1.2 mm.
- Before the system start-up verify that the water circuits are connected to the appropriate heat exchangers (e.g. no reversal between evaporator and condenser).
- Do not introduce any significant static or dynamic pressure into the heat exchange circuit (with regard to the design operating pressures).
- Before any start-up verify that the heat exchange fluid is compatible with the materials and the water circuit coating.
- The use of different metals on hydraulic piping could generate electrolytic pairs and consequently corrosion. It could be needed to add sacrificial anodes.

In case additives or other fluids than those recommended by Carrier are used, ensure that the fluids are not considered as a gas, and that they belong to class 2, as defined in directive 97/23/EC.

Carrier recommendations on heat exchange fluids:

- No NH_4^+ ammonium ions in the water, they are very detrimental for copper. This is one of the most important factors for the operating life of copper piping. A content of several tenths of mg/l will badly corrode the copper over time.
- Cl^- Chloride ions are detrimental for copper with a risk of perforations by corrosion by puncture. If possible keep below 125 mg/l.
- SO_4^{2-} sulphate ions can cause perforating corrosion, if their content is above 30 mg/l.
- No fluoride ions (<0.1 mg/l).
- No Fe^{2+} and Fe^{3+} ions with non negligible levels of dissolved oxygen must be present. Dissolved iron < 5 mg/l with dissolved oxygen < 5 mg/l.
- Dissolved silica: silica is an acid element of water and can also lead to corrosion risks. Content < 1 mg/l.
- Water hardness: > 0.5 mmol/l. Values between 1 and 2.5 can be recommended. This will facilitate scale deposit that can limit corrosion of copper. Values that are too high can cause piping blockage over time. A total alkalimetric titre (TAC) below 100 mg/l is desirable.
- Dissolved oxygen: Any sudden change in water oxygenation conditions must be avoided. It is as detrimental to deoxygenate the water by mixing it with inert gas as it is to over-oxygenate it by mixing it with pure oxygen. The disturbance of the oxygenation conditions encourages destabilisation of copper hydroxides and enlargement of particles.
- Electric conductivity 10-600 $\mu\text{S}/\text{cm}$.
- pH: Ideal case pH neutral at 20-25°C
 $7 < \text{pH} < 8$

If the water circuit must be emptied for longer than one month, the complete circuit must be placed under nitrogen charge to avoid any risk of corrosion by differential aeration.

Charging and removing heat exchange fluids should be done with devices that must be included on the water circuit by the installer. Never use the unit heat exchangers to add heat exchange fluid.

7.2 - Water connections

The water connections are Victaulic type connections. The inlet and outlet connection diameters are identical.

Inlet/outlet diameters

Standard-efficiency units 30XW-- / 30XWH-																					
Size		254	304	354	402	452	552	602	652	702	802	852	1002	1052	1154	1252	1352	1452	1552	1652	1702
Evaporator																					
Units without option 100C																					
Nominal diameter	in	5	5	5	5	5	5	5	6	6	6	6	6	6	8	8	8	8	8	8	8
Actual outside diameter	mm	141.3	141.3	141.3	141.3	141.3	141.3	141.3	168.3	168.3	168.3	168.3	168.3	168.3	219.1	219.1	219.1	219.1	219.1	219.1	219.1
Option 100C																					
Nominal diameter	in	5	5	5	6	6	6	6	6	6	6	6	6	6	8	8	8	8	8	8	8
Actual outside diameter	mm	141.3	141.3	141.3	168.3	168.3	168.3	168.3	168.3	168.3	168.3	168.3	168.3	168.3	219.1	219.1	219.1	219.1	219.1	219.1	219.1
Condenser																					
Units without option 102C																					
Nominal diameter	in	5	5	5	5	5	5	5	6	6	6	8	8	8	8	8	8	8	8	8	8
Actual outside diameter	mm	141.3	141.3	141.3	141.3	141.3	141.3	141.3	168.3	168.3	168.3	219.1	219.1	219.1	219.1	219.1	219.1	219.1	219.1	219.1	219.1
Option 102C																					
Nominal diameter	in	6	6	6	6	6	6	6	8	8	8	8	8	8	8	8	8	8	8	8	8
Actual outside diameter	mm	168.3	168.3	168.3	168.3	168.3	168.3	168.3	219.1	219.1	219.1	219.1	219.1	219.1	219.1	219.1	219.1	219.1	219.1	219.1	219.1

High-efficiency units 30XW-P / 30XWHP												
Size		512	562	712	812	862	1012	1162	1314	1464	1612	1762
Evaporator												
Units without option 100C												
Nominal diameter	in	6	6	8	8	8	8	8	8	8	10	10
Actual outside diameter	mm	168.3	168.3	219.1	219.1	219.1	219.1	219.1	219.1	219.1	273.1	273.1
Option 100C												
Nominal diameter	in	6	6	8	8	8	8	8	8	8	10	10
Actual outside diameter	mm	168.3	168.3	219.1	219.1	219.1	219.1	219.1	219.1	219.1	273.1	273.1
Condenser												
Units without option 102C												
Nominal diameter	in	6	6	8	8	8	8	8	8	8	10	10
Actual outside diameter	mm	168.3	168.3	219.1	219.1	219.1	219.1	219.1	219.1	219.1	273.1	273.1
Option 102C												
Nominal diameter	in	8	8	8	8	8	8	8	8	8	10	10
Actual outside diameter	mm	219.1	219.1	219.1	219.1	219.1	219.1	219.1	219.1	219.1	273.1	273.1

7.3 - Flow control

Evaporator flow switch and chilled water pump interlock


IMPORTANT: On 30XW units, the unit water flow switch must be energised. Failure to follow this instruction will void the Carrier guarantee.

The water flow switch is installed on the evaporator water inlet and adjusted by the control, based on unit size and application. If adjustment is necessary, it must be carried out by qualified personnel trained by Carrier Service.

7.4 - Evaporator and condenser water box bolt tightening

The evaporator (and condenser) are of the shell and tube type with removable water boxes to facilitate cleaning. Re-tightening or tightening must be done in accordance with the illustration in the example below.

Water box tightening sequence

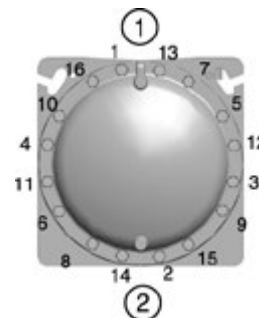

Legend

- | | | | |
|---|-------------------------|---|------------------------------|
| 1 | Sequence 1: 1 2 3 4 | 2 | Tightening torque |
| | Sequence 2: 5 6 7 8 | | Bolt size M16 - 171 - 210 Nm |
| | Sequence 3: 9 10 11 12 | | |
| | Sequence 4: 13 14 15 16 | | |

NOTE: Before this operation we recommend draining the circuit and disconnecting the pipes to be sure that the bolts are correctly and uniformly tightened.

7.5 - Operation of two units in master/slave mode


The control of a master/slave assembly is in the entering water and does not require any additional sensors (standard configuration). It can also be located in the leaving water. In this case two additional sensors must be added on the common piping.

All parameters, required for the master/slave function must be configured using the MST_SLV menu.

All remote controls of the master/slave assembly (start/stop, set point, load shedding etc.) are controlled by the unit configured as master and must only be applied to the master unit.

Each unit controls its own water pump. If there is only one common pump, in cases with variable flow, isolation valves must be installed on each unit. They will be activated at the opening and closing by the control of each unit (in this case the valves are controlled using the dedicated water pump outputs). See the 30XA/30XW Pro-Dialog Control IOM for a more detailed explanation.

30XW with configuration: leaving water control

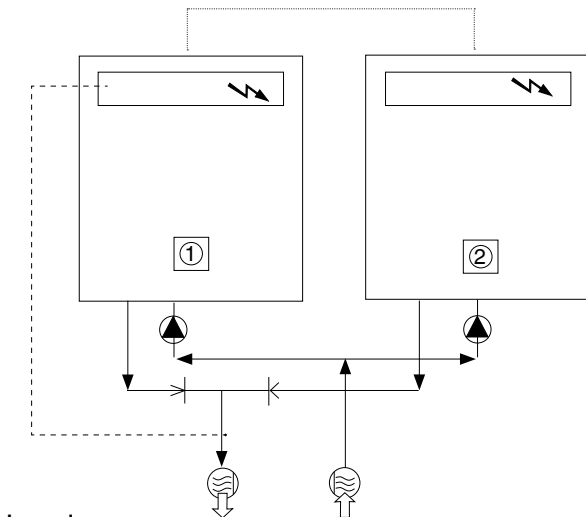

Legend

- ① Master unit
- ② Slave unit
- ⚡ Control boxes of the master and slave units
- 🌊➡ Water inlet
- 🌊➡ Water outlet
- ⚙️ Water pumps for each unit (included as standard for units with hydronic module)
- Additional sensors for leaving water control, to be connected to channel 1 of the slave boards of each master and slave unit
- CCN communication bus
- Connection of two additional sensors

8 - HEAT MACHINE UNITS 30XWH- AND 30XWHP

8.1 - Physical data for Heat Machine units

The physical data for the Heat Machine units 30XWH-/30XWHP are the same as for the 30XW--/30XW-P units. Please refer to chapter 4.1.

8.2 - Electrical data for Heat Machine units

The electrical data for the Heat Machine units 30XWH-/30XWHP are the same as for the 30XW--/30XW-P units. Please refer to chapter 4.2.

8.3 - Dimensions and clearances for Heat Machine units

The dimensions and clearances are the same as for the 30XW--/30XW-P units. Please refer to chapter 3.

8.4 - Operating range for Heat Machine units

The operating limits are the same as for the 30XW--/30XW-P units. Please refer to chapter 6.1.

8.5 - Operating modes for Heat Machine units

8.5.1 - Cooling mode

This operating mode is the same as that for 30XW units. The unit controls on the cooling setpoint.

8.5.2 - Heating mode

Unlike in the cooling mode, the unit uses the heating setpoint in this configuration. The evaporator leaving water control (lowest setpoint taken into consideration) is still maintained to prevent operation at very low temperatures.

9.2 - Electrical data, units with option 150

Standard-efficiency units (option 150)

30XW--/30XWH		254	304	354	402	452	552	602	652	702	802	852	1002	1052	1154	1252	1352	1452	1552	1652	1702	
Power circuit																						
Nominal power supply	V-ph-Hz	400-3-50																				
Voltage range	V	360-440																				
Control circuit		24 V via the built-in transformer																				
Nominal start-up current*																						
Circuit A	A	303	388	388	587	587	587	587	772	772	772	772	587	587	587	772	772	772	772	772	772	
Circuit B	A	-	-	-	-	-	-	-	-	-	-	-	587	587	587	587	772	772	772	772	772	
Option 81	A	-	-	-	-	-	-	-	-	-	-	-	757	757	757	943	965	986	1004	1004	1004	
Maximum start-up current**																						
Circuit A	A	303	388	388	587	587	587	587	772	772	772	772	587	587	587	772	772	772	772	772	772	
Circuit B	A	-	-	-	-	-	-	-	-	-	-	-	587	587	587	587	772	772	772	772	772	
Option 81	A	-	-	-	-	-	-	-	-	-	-	-	887	887	887	1072	1172	1202	1232	1004	1232	
Cosine phi nominal***		0.79	0.78	0.79	0.83	0.85	0.85	0.85	0.84	0.86	0.87	0.87	0.85	0.85	0.86	0.85	0.86	0.85	0.86	0.87	0.86	0.87
Cosine phi maximum****		0.88	0.87	0.88	0.90	0.90	0.91	0.91	0.90	0.90	0.90	0.90	0.90	0.91	0.91	0.91	0.91	0.91	0.91	0.91	0.91	0.91
Total harmonic distortion****		%	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Maximum power input†																						
Circuit A	kW	97	111	122	156	173	191	191	249	268	286	286	191	191	191	252	252	271	290	290	290	
Circuit B	kW	-	-	-	-	-	-	-	-	-	-	-	173	191	191	191	252	271	290	271	290	
Option 81	kW	-	-	-	-	-	-	-	-	-	-	-	364	382	382	443	504	542	580	562	580	
Nominal current drawn***																						
Circuit A	A	95	109	125	150	162	171	171	193	214	232	232	171	171	171	210	210	230	250	250	250	
Circuit B	A	-	-	-	-	-	-	-	-	-	-	-	162	171	171	171	210	230	250	230	250	
Option 81	A	-	-	-	-	-	-	-	-	-	-	-	333	342	342	381	420	460	500	480	500	
Maximum current drawn (Un)†																						
Circuit A	A	160	185	200	250	275	300	300	400	430	460	460	300	300	300	400	400	430	460	460	460	
Circuit B	A	-	-	-	-	-	-	-	-	-	-	-	275	300	300	300	400	430	460	430	460	
Option 81	A	-	-	-	-	-	-	-	-	-	-	-	575	600	600	700	800	860	920	890	920	
Max. current drawn (Un -10%)****																						
Circuit A	A	176	206	224	270	300	330	330	419	455	476	476	330	330	330	419	419	455	476	476	476	
Circuit B	A	-	-	-	-	-	-	-	-	-	-	-	300	330	330	330	419	455	476	455	476	
Option 81	A	-	-	-	-	-	-	-	-	-	-	-	630	660	660	749	838	910	952	931	952	
High-efficiency units (option 150)																						
30XW-P/30XWHP		512	562	712	812	862	1012	1162	1314	1464	1612	1762										
Power circuit																						
Nominal power supply	V-ph-Hz	400-3-50																				
Voltage range	V	360-440																				
Control circuit		24 V via the built-in transformer																				
Nominal start-up current*																						
Circuit A	A	587	587	772	772	772	587	587	772	772	772	772										
Circuit B	A	-	-	-	-	-	587	587	587	772	772	772										
Option 81	A	-	-	-	-	-	749	757	943	965	986	1004										
Maximum start-up current**																						
Circuit A	A	587	587	772	772	772	587	587	772	772	772	772										
Circuit B	A	-	-	-	-	-	587	587	587	772	772	772										
Option 81	A	-	-	-	-	-	862	887	1072	1172	1202	1232										
Cosine phi nominal***		0.88	0.88	0.84	0.86	0.87	0.87	0.88	0.86	0.85	0.86	0.87										
Cosine phi maximum****		0.91	0.92	0.90	0.90	0.90	0.91	0.92	0.91	0.91	0.91	0.91										
Total harmonic distortion****		%	0	0	0	0	0	0	0	0	0	0										
Maximum power input†																						
Circuit A	kW	173	191	252	271	290	173	191	252	252	271	290										
Circuit B	kW	-	-	-	-	-	173	191	191	252	271	290										
Option 81	kW	-	-	-	-	-	346	382	443	504	542	580										
Nominal current drawn***																						
Circuit A	A	162	171	210	230	250	162	171	210	210	230	250										
Circuit B	A	-	-	-	-	-	162	171	171	210	230	250										
Option 81	A	-	-	-	-	-	324	342	381	420	460	500										
Maximum current drawn (Un)†																						
Circuit A	A	275	300	400	430	460	275	300	400	400	430	460										
Circuit B	A	-	-	-	-	-	275	300	300	400	430	460										
Option 81	A	-	-	-	-	-	550	600	700	800	860	920										
Maximum current drawn (Un -10%)****																						
Circuit A	A	300	330	419	455	476	300	330	419	419	455	476										
Circuit B	A	-	-	-	-	-	300	330	330	419	455	476										
Option 81	A	-	-	-	-	-	600	660	749	838	910	952										

* Instantaneous start-up current (maximum operating current of the smallest compressor(s) + locked rotor current or reduced start-up current of the largest compressor). Values based on standard Eurovent unit operating conditions: evaporator entering/leaving water temp. = 12°C/7°C, condenser entering/leaving water temp. = 30°C/35°C.

** Instantaneous start-up current (maximum operating current of the smallest compressor(s) + locked rotor current or reduced start-up current of the largest compressor). Values obtained at operation with maximum unit power input.

*** Values based on standard Eurovent unit operating conditions: evaporator entering/leaving water temp. = 12°C/7°C, condenser entering/leaving water temp. = 30°C/35°C.

**** Values obtained at operation with maximum unit power input.

† Values obtained at operation with maximum unit power input. Values given on the unit name plate.

9.3 - Dimensions and clearances, units with option 150

Please refer to chapter 3.


9.4 - Operating limits, units with option 150

30XW--/30XWH-/30XW-P/30XWHP	Minimum	Maximum
Evaporator		
Entering temperature at start-up	-	35.0°C
Leaving temperature during operation	3.3°C*	15.0°C
Entering/leaving temperature difference at full load	2.8 K	11.1 K
Condenser		
Entering temperature at start-up	13.0°C**	-
Leaving temperature during operation	23.0°C**	63.0°C
Entering/leaving temperature difference at full load	2.8 K	11.1 K

* For low-temperature applications, where the leaving water temperature is below 3.3°C, a frost protection solution must be used. Please refer to option 5 and option 6.

** For lower condenser temperatures a water flow control valve must be used at the condenser (two or three-way valve). Please refer to option 152 to ensure the correct condensing temperature.

Note: Ambient temperatures: During storage and transport of the 30XW units (including by container) the minimum and maximum permissible temperatures are -20°C and 72°C (and 65°C for option 200).

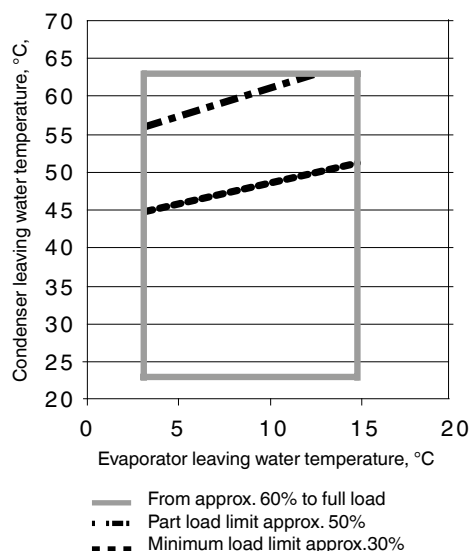

For more precise details refer to the unit selection program.

10 - MEDIUM TEMPERATURE (OPTION 5) AND LOW TEMPERATURE (OPTION 6) GLYCOL SOLUTION OPTIONS

Units with the medium temperature (option 5) or low temperature (option 6) option allow glycol solution production down to:

- 6°C with ethylene glycol and option 5 (minimum weight concentration of 25%)
- 3°C with propylene glycol and option 5 (minimum weight concentration of 24%)
- 12°C with ethylene glycol and option 6 (minimum weight concentration of 35%)
- 8°C with propylene glycol and option 6 (minimum weight concentration of 30%)

These options are available for the following unit reference numbers:

30XW- P0512
30XW- P0562
30XW- P1012
30XW--1152

Option 100C (evaporator with one pass) is not compatible with options 5 and 6. For option 5 the evaporator must be configured with two passes and for option 6 with three passes.

10.1 - Physical data, units with options 5 and 6

Standard-efficiency and high-efficiency 30XW- / 30XWH units (options 5 and 6)

30XW--/30XWH (reference)		Option 5 (medium temperature)				Option 6 (low temperature)			
		P0512	P0562	P1012	-1154	P0512	P0562	P1012	-1154
Operating weight	kg	2883	2927	6567	5607	2932	2976	6687	5705
Compressors		Semi-hermetic 06T screw compressors, 50 r/s							
Circuit A		1	1	1	1	1	1	1	1
Circuit B		-	-	1	1	-	-	1	1
Refrigerant charge*		R-134a							
Circuit A	kg	140	140	125	110	140	140	125	110
Circuit B	kg	-	-	125	110	-	-	125	110
Oil charge		SW220							
Circuit A	l	32	32	32	32	32	32	32	32
Circuit B	l	-	-	32	32	-	-	32	32
Capacity control		Pro-Dialog, electronic expansion valves (EXV)							
Minimum capacity	%	30	30	20	20	30	30	20	20
Evaporator		Multi-pipe flooded type							
Net water volume	l	70	70	204	183	85	85	224	197
Water connections		Victaulic							
Inlet/outlet	in	6	6	8	8	5	5	6	6
Drain and vent connections (NPT)	in	3/8	3/8	3/8	3/8	3/8	3/8	3/8	3/8
Maximum water-side operating pressure	kPa	1000	1000	1000	1000	1000	1000	1000	1000
Condenser		Multi-pipe							
Net water volume	l	103	103	316	193	103	103	316	193
Water connections		Victaulic							
Inlet/outlet	in	6	6	8	8	6	6	8	8
Drain and vent connections (NPT)	in	3/8	3/8	3/8	3/8	3/8	3/8	3/8	3/8
Maximum water-side operating pressure	kPa	1000	1000	1000	1000	1000	1000	1000	1000

* Weights are guidelines only. The refrigerant charge is given on the unit nameplate.

10.2 - Electrical data, units with options 5 and 6

The electrical data of 30XW units with options 5 and 6 are the same as for 30XW units with option 150. Please refer to chapter 9.2.

10.3 - Dimensions, clearances, units with option 5 and 6


The dimensions and clearances are the same as for 30XW units. Please refer to chapter 3.

10.4 - Operating range, units with options 5 and 6

	Minimum	Maximum
Evaporator		
Entering water temperature at start-up	-	35°C
Leaving temperature during operation*		
EG 5 Option 5 with ethylene glycol	-6°C	15°C
PG 5 Option 5 with propylene glycol	-3°C	15°C
EG 6 Option 6 with ethylene glycol	-12°C	15°C
PG 6 Option 6 with propylene glycol	-8°C	15°C
Entering/leaving temperature difference at full load	2.8 K	11.1 K***
Condenser		
Entering water temperature at start-up	13°C**	-
Leaving temperature during operation	19°C/23°C**	55°C/63°C****
Entering/leaving temperature difference at full load	2.8 K	11.1 K

- * The operating range with evaporator leaving temperatures above 3°C is permitted, but the performances are not optimised.
- ** For lower condenser temperatures a water flow control valve must be installed at the condenser (two-way or three-way). Please refer to option 152 to ensure the correct condensing temperature.
- *** Please refer to chapter 10.5 for the minimum recommended evaporator glycol flow rate.
- **** Depends on the conditions at the evaporator and the load conditions.

Note: Ambient temperatures: During storage and transport of the 30XW units (including by container) the minimum and maximum permissible temperatures are -20°C and 72°C (and 65°C for option 200).

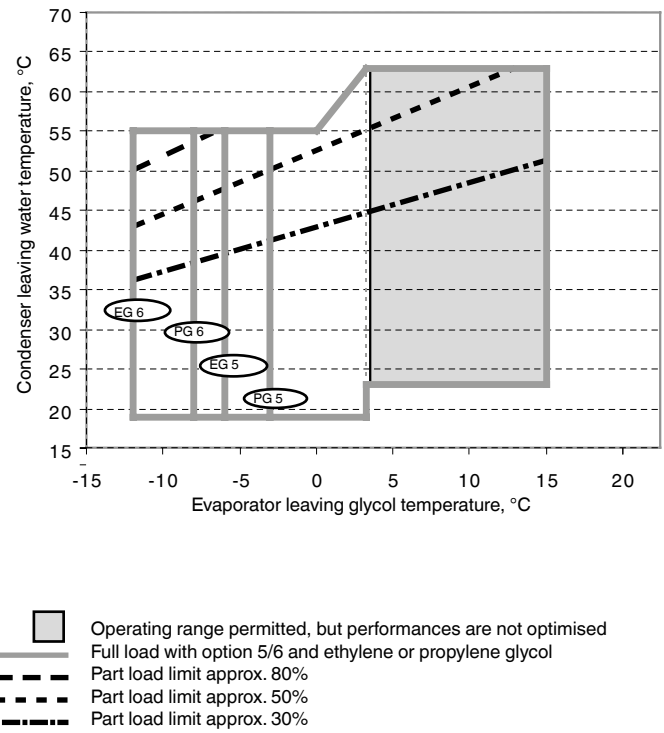

10.5 - Minimum recommended evaporator flow rate with options 5 and 6

Reference number	Option 5 (medium temperature)				Option 6 (low temperature)			
	P0512	P0562	P1012	-1154	P0512	P0562	P1012	-1154
Minimum evaporator flow rate*	l/s 17	19	36	40	14	14	27	29
Minimum evaporator flow rate**	l/s 17	19	36	41	14	16	31	32

- * Recommended values with ethylene glycol at the evaporator. Minimum concentration of 25% with option 5 and of 35% with option 6.
- ** Recommended values with propylene glycol at the evaporator. Minimum concentration of 24% with option 5 and of 30% with option 6.

Note: The minimum flow rates are for information only. For more precise details refer to the unit selection program.

10.6 - Nominal evaporator pressure drop with options 5 and 6

Reference number	Option 5 (medium temperature)				Option 6 (low temperature)			
	P0512	P0562	P1012	-1154	P0512	P0562	P1012	-1154
Nominal evaporator flow rate*	l/s 19	21	40	45	14	16	29	34
Nominal evaporator pressure drop*	kPa 40	50	61	75	48	65	77	107
Nominal evaporator flow rate**	l/s 19	21	40	46	15	16	30	35
Nominal evaporator pressure drop**	kPa 43	54	65	81	51	65	81	115

Option 5

- * Values based on 25% ethylene glycol, evaporator entering/leaving water temperatures of -2°C/-6°C and condenser entering/leaving water temperatures of 30°C/35°C.
- ** Values based on 24% propylene glycol, evaporator entering/leaving water temperatures of +1°C/-3°C and condenser entering/leaving water temperatures of 30°C/35°C.

Option 6

- * Values based on 35% ethylene glycol, evaporator entering/leaving water temperatures of -8°C/-12°C and condenser entering/leaving water temperatures of 30°C/35°C.
- ** Values based on 30% propylene glycol, evaporator entering/leaving water temperatures of -4°C/-8°C and condenser entering/leaving water temperatures of 30°C/35°C.

11 - MAJOR SYSTEM COMPONENTS AND OPERATION DATA

11.1 - Direct-drive twin-screw compressor with variable capacity slide valve

- 30XW units use 06T geared twin-screw compressors equipped with a variable capacity slide valve for continuous control between 15% and 100% of full load.
- The 06T compressor models used are: 06TT-266, 06TT-301, 06TT-356, 06TU-483, 06TU-554, 06TV-680, 06TV-753, 06TV-819

11.1.1 - Oil filter

The 06T screw compressor has an independent oil filter.

11.1.2 - Refrigerant

The 30XW is a liquid chiller operating only with refrigerant R-134a.

11.1.3 - Lubricant

The 06T screw compressor is approved for use with the following lubricant: CARRIER MATERIAL SPEC PP 47-32.

11.1.4 - Oil supply solenoid valve

An oil supply solenoid valve is installed on the oil return line as standard to isolate the compressor from oil flow when the compressor is not operating. The oil solenoid valve is field replaceable.

11.1.5 - Capacity control system

The 06T screw compressor has an unloading system that is standard on all compressors. This unloading system consists of slide valve that permits changing the length of the screw used for the refrigerant compression. This valve is controlled by the action of a piston controlled by two solenoid valves on the oil return line.

11.1.6 - Suction valve (option 92)

An isolating valve can be added to ease maintenance on compressor. This valve can be moved only without pressure differential upstream and downstream of this valve.

11.2 - Pressure vessels

General

Monitoring during operation, re-qualification, re-testing and re-testing dispensation:

- Follow the regulations on monitoring pressurised equipment.
- It is normally required that the user or operator sets up and maintains a monitoring and maintenance file.
- If no regulations exist or to complement regulations, follow the control programmes of EN 378.
- If they exist follow local professional recommendations.
- Regularly inspect the condition of the coating (paint) to detect blistering resulting from corrosion. To do this, check a non-insulated section of the container or the rust formation at the insulation joints.
- Regularly check for possible presence of impurities (e.g. silica grains) in the heat exchange fluids. These impurities maybe the cause of the wear or corrosion by puncture.

- Filter the heat exchange fluid check and carry out internal inspections as described in EN 378.
- In case of re-testing please refer to the maximum operating pressure given on the unit nameplate.
- The reports of periodical checks by the user or operator must be included in the supervision and maintenance file.

Repair

Any repair or modification, including the replacement of moving parts:

- must follow local regulations and be made by qualified operators and in accordance with qualified procedures, including changing the heat exchanger tubes.
- must be made in accordance with the instructions of the original manufacturer. Repair and modification that necessitate permanent assembly (soldering, welding, expanding etc.) must be made using the correct procedures and by qualified operators.
- An indication of any modification or repair must be shown in the monitoring and maintenance file.

Recycling

The unit is wholly or partly recyclable. After use it contains refrigerant vapours and oil residue. It is coated by paint.

Operating life

The evaporator and oil separator are designed for:

- prolonged storage of 15 years under nitrogen charge with a temperature difference of 20 K per day.
- 452000 cycles (start-ups) with a maximum difference of 6 K between two neighbouring points in the vessel, based on 6 start-ups per hour over 15 years at a usage rate of 57%.

Corrosion allowances:

Gas side: 0 mm

Heat exchange fluid side: 1 mm for tubular plates in lightly alloyed steels, 0 mm for stainless steel plates or plates with copper-nickel or stainless steel protection.

11.2.1 - Evaporator

30XW chillers use a flooded multi-tube evaporator. The water circulates in the tubes and the refrigerant is on the outside in the shell. One vessel is used to serve both refrigerant circuits. There is a centre tube sheet which separates the two refrigerant circuits. The tubes are 3/4" diameter copper with an enhanced surface inside and out. There is just one water circuit with two water passes (one pass with option 100C, please refer to chapter 6.5).

The evaporator shell has a polyurethane foam thermal insulation and a water drain and purge.

It has been tested and stamped in accordance with the applicable pressure codes. The maximum standard relative operating pressure is 2100 kPa for the refrigerant-side and 1000 kPa for the water-side. These pressures can be different depending on the code applied. The water connection of the heat exchanger is a Victaulic connection.

The products that may be added for thermal insulation of the containers during the water piping connection procedure must be chemically neutral in relation to the materials and coatings to which they are applied. This is also the case for the products originally supplied by Carrier.

11.2.2 - Condenser and oil separator

The 30XW chiller uses a heat exchanger that is a combination condenser and oil separator. It is mounted below the evaporator. Discharge gas leaves the compressor and flows through an external muffler to the oil separator, which is the upper portion of the heat exchanger. It enters the top of the separator where oil is removed, and then flows to the bottom portion of the vessel, where gas is condensed and subcooled. One vessel is used to serve both refrigerant circuits. There is a center tube sheet which separates the two refrigerant circuits. The tubes are 3/4" or 1" diameter internally and externally finned copper tubes.

There is just one water circuit with two water passes (one pass with option 102C, please refer to chapter 6.5). For the Heat Machine units the condenser shell can have a polyurethane foam thermal insulation (option 86) and a water drain and purge.

It has been tested and stamped in accordance with applicable pressure codes. The maximum standard relative operating pressure is 2100 kPa for the refrigerant-side and 1000 kPa for the water-side. These pressures can be different depending on the code applied. The water connection of the heat exchanger is a Victaulic connection.

11.2.3 - Economiser function (depending on model)

The economiser function includes a liquid line valve, a filter drier, two electronic expansion valves (EXVs), a plate heat exchanger as well as protection devices (fuse or valve).

At the condenser outlet a part of the liquid is expanded via the secondary EXV in one of the heat exchanger circuits and then returns as a gas. This expansion permits increase of the liquid sub-cooling of the rest of the flow that penetrates the evaporator via the principal EXV. This permits increasing the cooling capacity of the system as well as its efficiency.

11.3 - High-pressure safety switch

30XW units are equipped with high-pressure safety switches.

In accordance with the applicable code the high-pressure switches with manual reset, called PZH (former DBK), may be backed up by high-pressure switches that require resetting with a tool. The high-pressure switches that require resetting with a tool are called PZHH (former SDBK). If a PZHH cuts out, the corresponding PZH in the same compressor is faulty and must be replaced. The PZHH must be reset with a blunt tool with a diameter of less than 6 mm. Insert this tool into the opening on the pressure switch and push the reset button in this location.

These pressure switches are located at the discharge of each compressor.

11.4 - Electronic expansion valve (EXV)

The EXV is equipped with a stepper motor (2785 to 3690 steps, depending on the model) that is controlled via the EXV board.

The EXV is also equipped with a sightglass that permits verification of the mechanism movement and the presence of the liquid gasket.

11.5 - Moisture indicator

Located on the EXV, permits control of the unit charge and indicates moisture in the circuit. The presence of bubbles in the sight-glass indicates an insufficient charge or non-condensables in the system. The presence of moisture changes the colour of the indicator paper in the sight-glass.

11.6 - Filter drier

The role of the filter drier is to keep the circuit clean and moisture-free. The moisture indicator shows, when it is necessary to change the element. A difference in temperature between the filter inlet and outlet shows that the element is dirty.

11.7 - Sensors

The units use thermistors to measure the temperature, and pressure transducers to control and regulate system operation (see 30XA/30XW Pro-Dialog Control IOM for a more detailed explanation).

12 - OPTIONS

Options	No.	Description	Advantages	Use for 30XW range
Medium-temperature brine solution	5	Implementation of new algorithms of control and evaporator redesign to allow chilled brine solution production down to -6°C when ethylene glycol is used (-3°C with propylene glycol)	Covers specific applications such as ice storage and industrial processes	Only sizes 512/562/1012/1154
Low-temperature brine solution	6	Implementation of new algorithms of control and evaporator redesign to allow chilled brine solution production down to -12°C when ethylene glycol is used (-8°C with propylene glycol)	Covers specific applications such as ice storage and industrial processes	Only sizes 512/562/1012/1154
Light-brine solution, down to -3°C	8	Implementation of new algorithms of control to allow chilled brine solution production down to -3°C when ethylene glycol is used (0°C with propylene glycol)	Matches with most application requirements for ground-sourced heat pumps and fits with many industrial processes requirements	254-1762
Unit supplied in two assembled parts	51	The unit is equipped with flanges that allow disassembly of the unit on site	Facilitates installation in plant rooms with limited access	Only sizes 1612/1652/1702/1762
Master/slave operation	58	Unit equipped with supplementary water outlet temperature sensor kit to be field-installed allowing master/slave operation of two units connected in parallel	Optimised operation of two chillers connected in parallel with operating time equalisation	254-1762
Single power connection point	81	Unit power connection via one main supply connection	Quick and easy installation	1002-1762
No disconnect switch, but short circuit protection	82A	Unit without disconnect switch, but with short-circuit protection device	Permits an external electrical disconnect system for the unit (field-supplied), while ensuring unit short circuit protection	254-1762
Evaporator pump electrical power / control circuit	84	Unit equipped with an electrical power and control circuit for one pump evaporator side	Quick and easy installation: The control of fixed speed pumps is embedded in the unit control	254-1252, 1314
Evaporator dual pumps electrical power / control circuit	84D	Unit equipped with an electrical power and control circuit for two pumps evaporator side	Quick and easy installation: The control of fixed speed pumps is embedded in the unit control	254-1252, 1314
Condenser pump electrical power / control circuit	84R	Unit equipped with an electrical power and control circuit for one pump condenser side	Quick and easy installation: The control of fixed speed pumps is embedded in the unit control	254-1252, 1314
Condenser insulation	86	Thermal condenser insulation	Minimizes thermal dispersions condenser side (key option for heat pump or heat recovery applications) and allows compliancy with special installation criteria (hot parts insulated)	254-1762
Service valve set	92	Liquid line valve (evaporator inlet) and compressor suction line valve	Allow isolation of various refrigerant circuit components for simplified service and maintenance	254-1762
Evaporator with one pass	100C	Evaporator with one pass on the water side. Evaporator inlet and outlet on opposite sides.	Easy to install, depending on site. Reduced pressure drops	254-1762
Condenser with one pass	102C	Condenser with one pass on the water side. Condenser inlet and outlet on opposite sides.	Easy to install, depending on site. Reduced pressure drops	254-1762
21 bar evaporator	104	Reinforced evaporator for extension of the maximum water-side service pressure to 21 bar (standard 10 bar)	Covers applications with a high water column evaporator side (typically high buildings)	254-1762
21 bar condenser	104A	Reinforced condenser for extension of the maximum water-side service pressure to 21 bar (standard 10 bar)	Covers applications with a high water column condenser side (typically high buildings)	254-1762
Reversed evaporator water connections	107	Evaporator with reversed water inlet/outlet	Easy installation on sites with specific requirements	254-1762
Reversed condenser water connections	107A	Condenser with reversed water inlet/outlet	Easy installation on sites with specific requirements	254-1762
JBus gateway	148B	Two-directional communication board complying with JBus protocol	Connects the unit by communication bus to a building management system	254-1762
LON gateway	148D	Two-directional communication board complying with Lon Talk protocol	Connects the unit by communication bus to a building management system	254-1762
Bacnet over IP gateway	149	Two-directional high-speed communication using BACnet protocol over Ethernet network (IP)	Easy and high-speed connection by ethernet line to a building management system. Allows access to multiple unit parameters	254-1762
High condensing temperature	150	Optimized compressor for operation at high condensing temperature	Increased condenser leaving water temperature up to 63°C. Allows applications with high condensing temperature (heat pumps, installations with not generously sized dry-coolers or more generally, installations with dry-coolers in hot climate). NOTE: to ensure control of the condenser leaving water temperature, this option must be fitted with 30XWH units.	254-1762
Condensing temperature limitation	150B	Limitation of the maximum condenser leaving water temperature to 45°C	Reduced maximum power input and current absorption: power cables and protection elements can therefore be downsized	254-1762
Control for low condensing temperature systems	152	Output signal (0-10 V) to control the condenser water inlet valve	Simple installation: for applications with cold water at condenser inlet (ex. ground-source, groundwater-source, superficial water-source applications) the signal permits to control a 2 or 3-way valve to maintain condenser water temperature (and so condensing pressure) at acceptable values	254-1762
Energy Management Module EMM	156	Control board with additional inputs/outputs. See Energy Management Module option chapter	Extended remote control capabilities (Set-point reset, ice storage end, demand limits, boiler on/off command...)	254-1762
Touch Pilot control, 7" user interface	158A	Touch Pilot control supplied with a 7 inch colour touch screen user interface	Enhanced ease of use	254-1762
Leak detection	159	0-10 V signal to report any refrigerant leakage in the unit directly on the controller (the leak detector itself must be supplied by the customer)	Immediate customer notification of refrigerant losses to the atmosphere, allowing timely corrective actions	254-1762
Compliance with Swiss regulations	197	Additional tests on the water heat exchangers: supply (additional of PED documents) supplementary certificates and test certifications	Conformance with Swiss regulations	254-1762
Compliance with Australian regulations	200	Unit approved to Australian code	Conformance with Australian regulations	254-1762
Low noise level	257	Evaporator sound insulation	3 dB(A) quieter than standard unit	254-1762
Welded evaporator water connection kit	266	Victaulic piping connections with welded joints	Easy installation	254-1762
Welded condenser water connection kit	267	Victaulic piping connections with welded joints	Easy installation	254-1762
Flanged evaporator water connection kit	268	Victaulic piping connections with flanged joints	Easy installation	254-1762
Flanged condenser water connection kit	269	Victaulic piping connections with flanged joints	Easy installation	254-1762
Thermal compressor insulation	271	The compressor is covered with a thermal insulation layer	Prevents air humidity to condensate on the compressor surface	254-1762
230V electrical plug	284	230V AC power supply source provided with plug socket and transformer (180 VA, 0,8 Amps)	Permits connection of a laptop or an electrical device during unit commissioning or servicing	254-1762
Carrier Connect link (BSS regions only)	298	3G router board NOTE 1: Require option 149 NOTE 2: When more than one machine is installed on site, only one of them shall be equipped with option 298 while all of them must be equipped with option 149 NOTE 3: If a CARRIER-PSM is on site, option 298 shall be integrated in the PSM while option 149 is still mandatory for each single unit.	Enabler for Carrier Connect service offer	254-1762

13 - STANDARD MAINTENANCE

Air conditioning equipment must be maintained by professional technicians, whilst routine checks can be carried out locally by specialised technicians. See the standard EN 378-4.

Simple preventive maintenance will allow you to get the best performance from your HVAC unit:

- improved cooling performance
- reduced power consumption
- prevention of accidental component failure
- prevention of major time-consuming and costly inter-ventions
- protection of the environment

There are five maintenance levels for HVAC units, as defined by the AFNOR X60-010 standard.

13.1 - Level 1 maintenance

See note below.

Simple procedure can be carried out by the user:

- Visual inspection for oil traces (sign of a refrigerant leak)
- Air heat exchanger (condenser) cleaning - see chapter "Condenser coil - level 1"
- Check for removed protection devices, and badly closed doors/covers
- Check the unit alarm report when the unit does not work (see report in the 30XA/30XW Pro-Dialog Plus control manual).

General visual inspection for any signs of deterioration.

13.2 - Level 2 maintenance

See note below.

This level requires specific know-how in the electrical, hydronic and mechanical fields. It is possible that these skills are available locally: existence of a maintenance service, industrial site, specialised subcontractor.

In these cases, the following maintenance operations are recommended.

Carry out all level 1 operations, then:

- At least once a year tighten the power circuit electrical connections (see tightening torques table).
- Check and re-tighten all control/command connections, if required (see tightening torques table).
- Check the differential switches for correct operation every 6 months.
- Remove the dust and clean the interior of the control boxes, if required. Check the filter condition.
- Check the presence and the condition of the electrical protection devices.
- Replace the fuses every 3 years or every 15000 hours (age-hardening).
- Replace the control box cooling fans (if used) every five years.
- Check the water connections.
- Purge the water circuit (see chapter 7 "Water connections").

- Clean the water filter (see chapter 7 "Water connections").
- Check the unit operating parameters and compare them with previous values.
- Keep and maintain a maintenance sheet, attached to each HVAC unit.

All these operations require strict observation of adequate safety measures: individual protection garments, compliance with all industry regulations, compliance with applicable local regulations and using common sense.

13.3 - Level 3 (or higher) maintenance

See note below.

The maintenance at this level requires specific skills/ approval/tools and know-how and only the manufacturer, his representative or authorised agent are permitted to carry out these operations. These maintenance operations concern for example:

- A major component replacement (compressor, evaporator)
- Any intervention on the refrigerant circuit (handling refrigerant)
- Changing of parameters set at the factory (application change)
- Removal or dismantling of the HVAC unit
- Any intervention due to a missed established maintenance operation
- Any intervention covered by the warranty

NOTE: Any deviation or non-observation of these maintenance criteria will render the guarantee conditions for the HVAC unit null and void, and the manufacturer, Carrier France, will no longer be held responsible.

13.4 - Tightening of the electrical connections

13.4.1 - Tightening torques for the main electrical connections


Screw type	Designation in the unit	Torque value, N·m
Screw on bus bar, customer connection		
M10	L1/L2/L3	40
M12	L1/L2/L3	70
Soldered screw PE, customer connection (M12)		
PE		70
Screw on fused disconnect inlet zones		
Fused disconnect 1034061/M10, customer connection	L1/L2/L3	40
Fused disconnect 1034061/M12, Y/D outlet	QS10-	70
Fused disconnect 3KL7141	QS10-	70
Fused disconnect 3KL7151	QS10-	70
Tunnel terminal screw, compressor contactor		
Contacteur 3RT104-	KM-	5
Contacteur 3RT105-	KM-	11
Contacteur 3RT106-	KM-	21
Tunnel terminal screw, current transformer		
Size 2 (3RB2966-)	TI-	11
Compressor earth terminal in the power wiring control box		
M12	Gnd	70
Compressor phase connection terminals		
M12	1/2/3/4/5/6 on EC-	25
M16	1/2/3/4/5/6 on EC-	30
Compressor earth connection		
	Gnd on EC-	25
Tunnel terminal screw, water pump disconnect		
Disconnect switch 3RV101-	QM90-	2,5
Disconnect switch 3RV102-	QM90-	2,5
Disconnect switch 3RV103-	QM90-	4
Tunnel terminal screw, water pump contactor		
Contacteur 3RT102-	KM90-	2,5
Contacteur 3RT103-	KM90-	4

13.4.2 - Connection precautions for the compressor power terminals

These precautions must be applied during an intervention that requires the removal of the power conductors connected to the compressor supply terminals.

The tightening nut of terminal (6) supporting the isolator (7) must never be loosened, as it ensures terminal tightness and compressor leak tightness.

The tightening of phase lug (4) must apply the torque between counter nut (5) and tightening nut (3): during this operation a counter-torque must be applied at counter nut (5). Counter-nut (5) must not be in contact with the tightening nut of terminal (6).

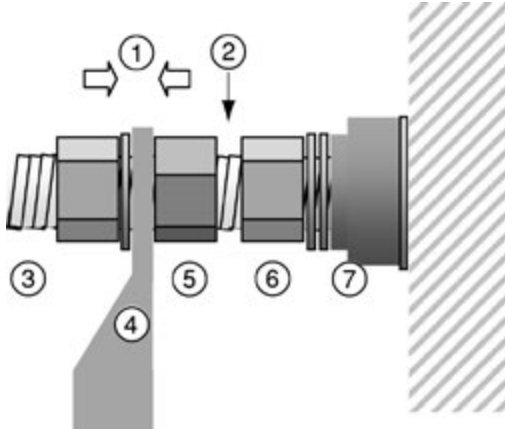


1. Torque application to tighten the lug
2. Avoid contact between the two nuts
3. Lug tightening nut
4. Flat lug
5. Counter-nut
6. Terminal tightening nut
7. Isolator

13.4.3 - Connection precautions for the power contactors

These precautions must be applied for units equipped with 06TUA554, 06TVW753 and 06TVW819 compressors. For these units the power contactor type is 3RT1064 (Siemens).

The contactors allow two connection positions in the cage clamps. But only one position allows safe and reliable tightening on the contactor (KM1 or KM2). The conductor must be positioned in front of the connection area when it is tightened. If it is tightened behind the area, there is a risk that the brackets will be damaged during the tightening.

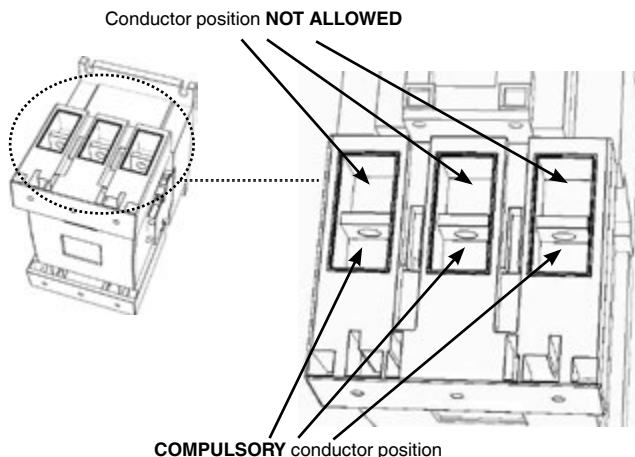

13.5 - Tightening torques for the main bolts and screws

Screw type	Used for	Torque value, N·m
M20 nut	Chassis	190
M20 nut	Heat exchanger side-side connection	240
M16 nut	Compressor fixing	190
H M16 screw	Heat exchanger water boxes, structure	190
H M16 screw	Compressor suction flanges TT	190
H M20 screw	Compressor suction flanges TU & TV	240
M16 nut	Compressor discharge line TT & TU	190
M20 nut	Compressor discharge line TV	240
H M12 screw	Economiser port flange & economiser port valve, option 92	80
H M8 screw	Drier cover	35
1/8 NPT connection	Oil line	12
TE nut	Compressor oil line	24,5
7/8 ORFS nut	Oil line	130
5/8 ORFS nut	Oil line	65
3/8 ORFS nut	Oil line	26
H M6 screw	Stauff collar	10
Taptite screw M6	Oil line collar	7
Taptite screw M6	Brass body, economiser line	10
Metric screw M6	Steel plate fixing, control box, terminal box	7
Taptite screw M10	Oil filter, economiser module, control box fixing	30

13.6 - Evaporator and condenser maintenance

Check that:

- the insulating foam is intact and securely in place,
- the sensors and flow switch are correctly operating and correctly positioned in their support,
- the water-side connections are clean and show no sign of leakage.

13.7 - Compressor maintenance

13.7.1 - Oil filter change schedule

As system cleanliness is critical to reliable system operation, there is a filter in the oil line at the oil separator outlet. The oil filter is specified to provide a high level of filtration (5 µm) required for long compressor life.

The filter should be checked after the first 500 hours of operation, and every subsequent 2000 hours. The filter should be replaced at any time when the pressure differential across the filter exceeds 2 bar.

The pressure drop across the filter can be determined by measuring the pressure at the discharge port (at the oil separator) and the oil pressure port (at the compressor). The difference in these two pressures will be the pressure drop across the filter, check valve, and solenoid valve. The pressure drop across the check valve and solenoid valve is approximately 0.4 bar, which should be subtracted from the two oil pressure measurements to give the oil filter pressure drop.

13.7.2 - Compressor rotation control

Correct compressor rotation is one of the most critical application considerations. Reverse rotation, even for a very short duration, damages the compressor and can even destroy it.

The reverse rotation protection scheme must be capable of determining the direction of rotation and stopping the compressor within one second. Reverse rotation is most likely to occur whenever the wiring at the compressor terminals has been modified.

To minimise the opportunity for reverse rotation, the following procedure must be applied. Rewire the power cables to the compressor terminal pin as originally wired. Apply a counter-torque at the lower nut at the supply cable terminal during installation.

For replacement of the compressor, a low pressure switch is included with the compressor. This low pressure switch should be temporarily installed as a hard safety on the high pressure part of the compressor. The purpose of this switch is to protect the compressor against any wiring errors at the compressor terminal pin. The electrical contact of the switch would be wired in series with the high pressure switch. The switch will remain in place until the compressor has been started and direction of rotation has been verified; at this point, the switch will be removed.

The switch that has been selected for detecting reverse rotation is Carrier part number HK01CB001. This switch opens the contacts when the pressure falls below 7 kPa. The switch is a manual reset type that can be reset after the pressure has once again risen above 70 kPa. It is critical that the switch be a manual reset type to preclude the compressor from short cycling in the reverse direction.

14 - START-UP CHECKLIST FOR 30XW LIQUID CHILLERS (USE FOR JOB FILE)

Preliminary information

Job name:
Location:
Installing contractor:
Distributor:

Unit

Model:

Compressors

Circuit A

Model number
Serial number
Motor number

Circuit B

Model number
Serial number
Motor number

Evaporator

Model number
Serial number

Condenser section

Model number
Serial number

Additional optional units and accessories
.....

Preliminary equipment check

Is there any shipping damage? If so, where?
.....
Will this damage prevent unit start-up?

- Unit is level in its installation
- Power supply agrees with the unit nameplate
- Electrical circuit wiring has been sized and installed properly
- Unit ground wire has been connected
- Electrical circuit protection has been sized and installed properly
- All terminals are tight
- All chilled water valves are open
- All chilled water piping is connected properly
- All air has been vented from the chilled water circuit
- The unit is switched off again, after the pump test has been completed
- Chilled water pump (CWP) is operating with the correct rotation. Check the phase sequence of the electrical connection.
- Circulate chilled water in the water circuit for at least two hours, then remove, clean and replace the screen filter. The unit is switched off again, after the pump test has been completed.
- Inlet piping to cooler includes a 20 mesh strainer with a mesh size of 1.2 mm.

Unit start-up

- Oil level is correct
- All discharge and liquid line valves are open
- Locate, repair and mark all refrigerant leaks
- All suction valves are open, if used
- All oil line valves and economizer valves (if used) are open
- Checks have been carried out for any possible leaks. Unit has been leak checked (including fittings)
 - on the whole unit
 - at all connections

Locate, repair, and report any refrigerant leaks.....

- Check voltage imbalance: AB..... AC..... BC.....
 Average voltage = V
 Maximum deviation = V
 Voltage imbalance = %
- Voltage imbalance is less than 2%

WARNING: Operation of the chiller with an improper supply voltage or excessive phase imbalance constitutes abuse which will invalidate the Carrier warranty. If the phase imbalance exceeds 2% for voltage, or 10% for current, contact your local electricity supplier at once and ensure that the chiller is not switched on until corrective measures have been taken.

Check cooler water loop

- Water loop volume = litres
- Calculated volume = litres
- 3.25 litres/nominal kW capacity for air conditioning
- 6.5 litres/nominal kW capacity for process cooling
- Proper loop volume established
- Proper loop corrosion inhibitor included.....litres of.....
- Proper loop freeze protection included (if required) litres of.....
- Piping includes electric heater tape, if exposed to temperatures below 0°C
- Inlet piping to cooler includes a 20 mesh strainer with a mesh size of 1.2 mm

Check pressure drop across the cooler

- Entering cooler = kPa
- Leaving cooler = kPa
- Leaving - entering = kPa

WARNING: Plot cooler pressure drop on performance data table (in product data literature) to determine total litres per second (l/s) and find unit's minimum flow rate.

- Total = l/s
- Nominal kW = l/s
- Total l/s is greater than unit's minimum flow rate
- Total l/s meets job specified requirement of..... l/s

WARNING: Once power is supplied to the unit, check for any alarms (refer to the 30XA/30XW Pro-Dialog control IOM for the alarm menu).

Note all alarms:.....

NOTE:

The pouch supplied with the unit contains the label indicating the refrigerant used and describing the procedure required under the Kyoto Protocol F-Gas Regulation:

- **Attach this label to the machine.**
- **Follow and observe the procedure described.**

Notes:.....



Order No: 13458, 03.2017 - Supersedes order No: 13458, 05.2015.
Manufacturer reserves the right to change any product specifications without notice.



www.eurovent-certification.com
www.certiflash.com



Quality and Environment
Management Systems
Approval

Manufacturer: Carrier SCS, Montluel, France.
Printed in the European Union.